






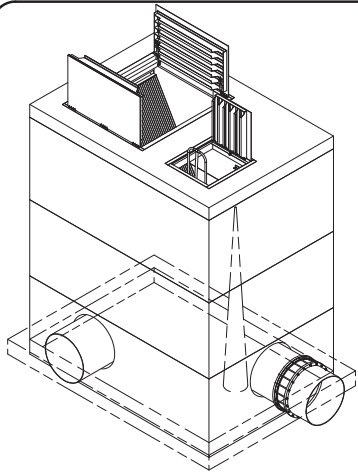


CONCRETE COATING

EXTERIOR OF MANHOLE, WET WELL, BAR SCREEN VAULT, AND VALVE VAULT TO BE COATED WITH POLYMORPHIC POLYESTER RESIN SYSTEM. CONCRETE COATING IS BY **SANCO**

UPLIFT COLLAR SUPPLIED IN THE FIELD AFTER VAULT IS INSTALLED BY **SANCO**. REBAR INSERTS WILL BE PRECAST INTO VAULT BASE. REBAR INSERTS AND REBAR ON 12" CENTERS ALL THE WAY AROUND THE BASE SUPPLIED AND INSTALLED BY **SANCO**.

NOTE: BAR SCREEN VAULT TOP SLAB IS H-20 OCCASIONAL TRAFFIC RATED

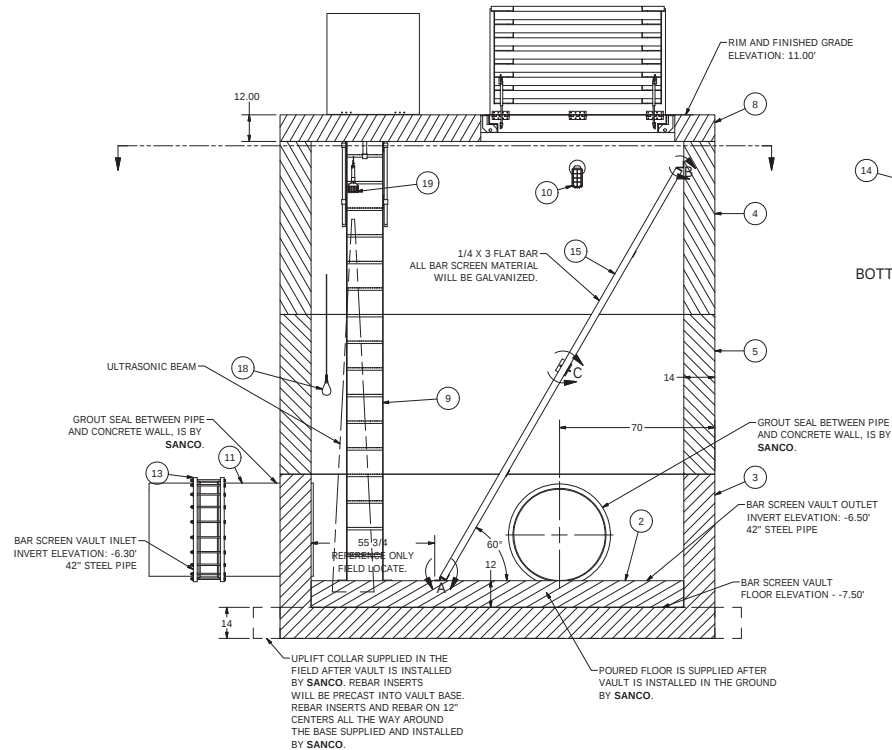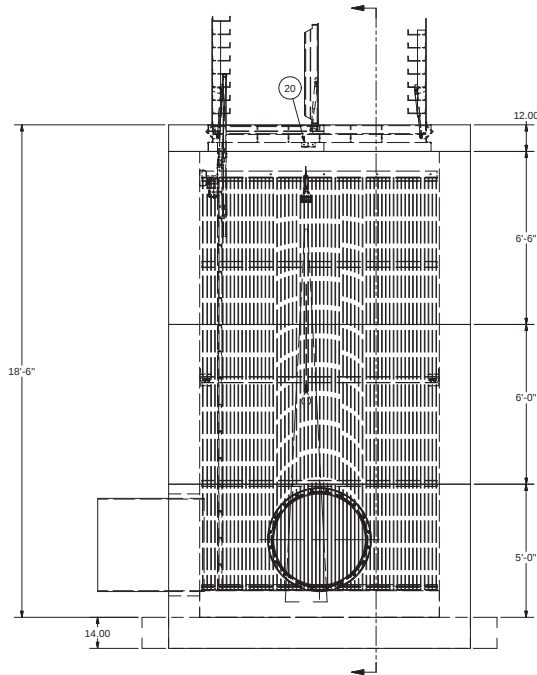

BAR SCREEN VAULT
9' X 14' INSIDE DIMENSIONS
42" INLET AND OUTLET PIPE

NOTE: ALL DIMENSIONS AND ELEVATIONS SHOWN ARE NOMINAL DIMENSIONS. IT IS THE RESPONSIBILITY OF THE ON-SITE CONTRACTOR OR ROMTEC UTILITIES CUSTOMER (NOT ROMTEC UTILITIES) TO VERIFY THE ACCURACY OF ANY CRITICAL DIMENSIONS OR ELEVATIONS PRIOR TO SETTING OR INSTALLING ANY EQUIPMENT.

© 2014 ROMTEC INC. ALL RIGHTS RESERVED. THESE PLANS AND DRAWINGS MAY NOT BE REPRODUCED, ADAPTED, OR FURTHER DISTRIBUTED, AND NO COMPONENTS MAY BE CONSTRUCTED FROM THESE PLANS, WITHOUT WRITTEN PERMISSION OF ROMTEC, INC.

REVISION HISTORY	DATE	APPROV
1	12/27/14	REV
0		DESIGN
0		CHECK
0		DATE
0		DATE
0		DATE

**COMPONENT
DRAWING**

**ROMTEC
UTILITIES**
18240 NORTH BANK ROAD
ROSEBURG, OREGON 97470
(541) 496-9678
FAX (541) 496-0804

REDWOOD CITY
**BAIR ISLAND STORM P. S.
BAR SCREEN VAULT**

SHEET
1 OF 1

JOB NUMBER
**RMTC
0000**