


FRONT VIEW

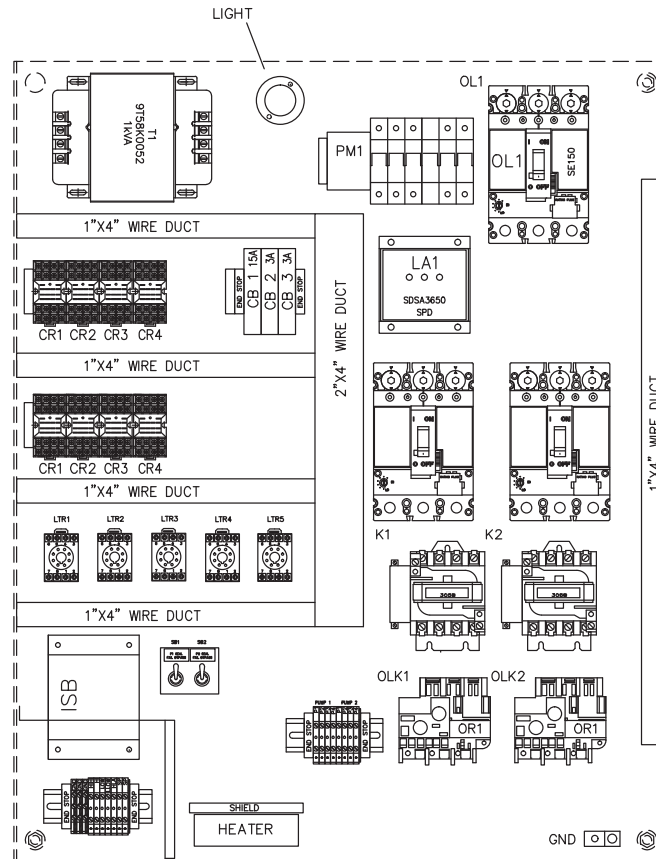


INSIDE VIEW


UL LABELS AS REQUIRED  
 (REAR OF DOOR)

- NOTES:  
 1. ELECTRICAL FEED IS DIRECT TO MAIN CIRCUIT BREAKER  
 2. MOTOR T-LEADS DIRECT TO OVERLOADS


CLIENT	ROMTEC UTILITIES
JOB NAME	CONTROL PANEL LAYOUT
	ELECTRICAL CONTROLS
	SIMPLEX LIFT STATION SYSTEM
SHEET	1 OF 2
DRAWING #	
DESCRIPTION	UL LISTED LIFT STATION CONTROL PANEL & PUMP DISCONNECT PANEL-DUPLEX PUMPS WITH OPTIONAL PERMANENT ON-SITE ELECTRICAL GENERATOR.
REV. DATE	6-18-09
BY	

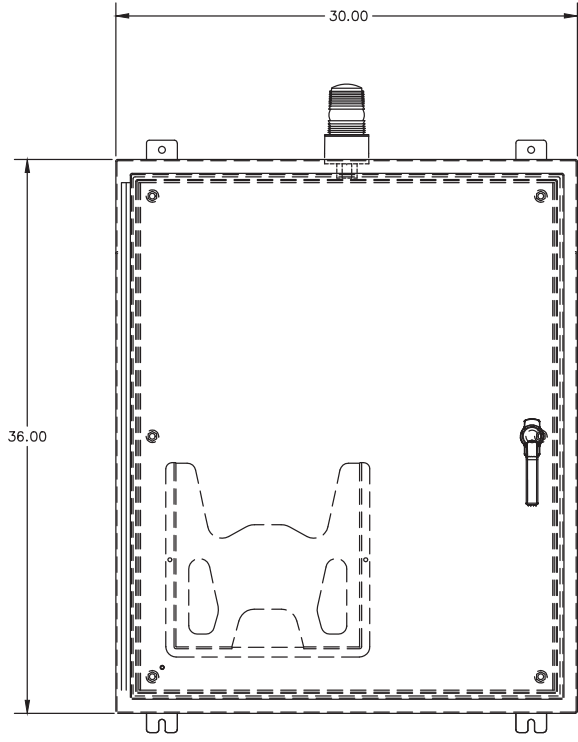

FRONT VIEW

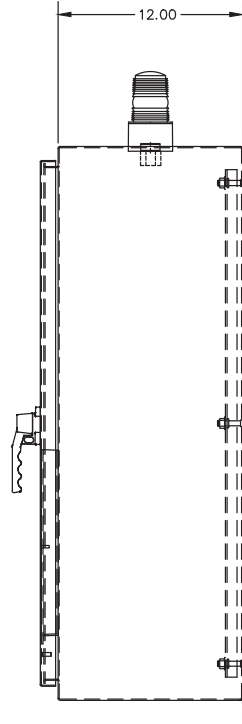

SIDE VIEW

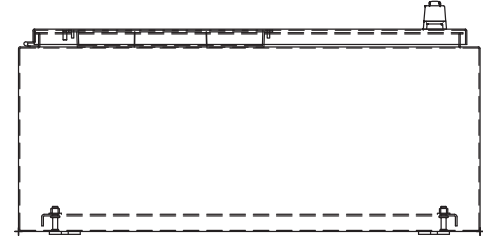

BOTTOM VIEW

CLIENT JOB NAME <b>CONTROL PANEL LAYOUT</b> <b>ELECTRICAL CONTROLS</b> <b>SIMPLEX LIFT STATION SYSTEM</b>	<b>ROMTEC</b> <b>UTILITIES</b> 18240 NORTH BANK ROAD ROSEBURG, OR 97470 (541)-496-3541 FAX (541)-496-0803 WWW.romtecutilities.com	U.L. LISTED LIFT STATION CONTROL PANEL - PUMP DISCONNECT PANEL - DUPLEX PUMPS WITH OPTIONAL PERMANENT ON-SITE ELECTRICAL GENERATOR.	
		SHEET 2 of 2 DRAWING #	REVISIONS NO. REV. DATE DESCRIPTION 6-18-09 SW SW SW