


FRONT VIEW

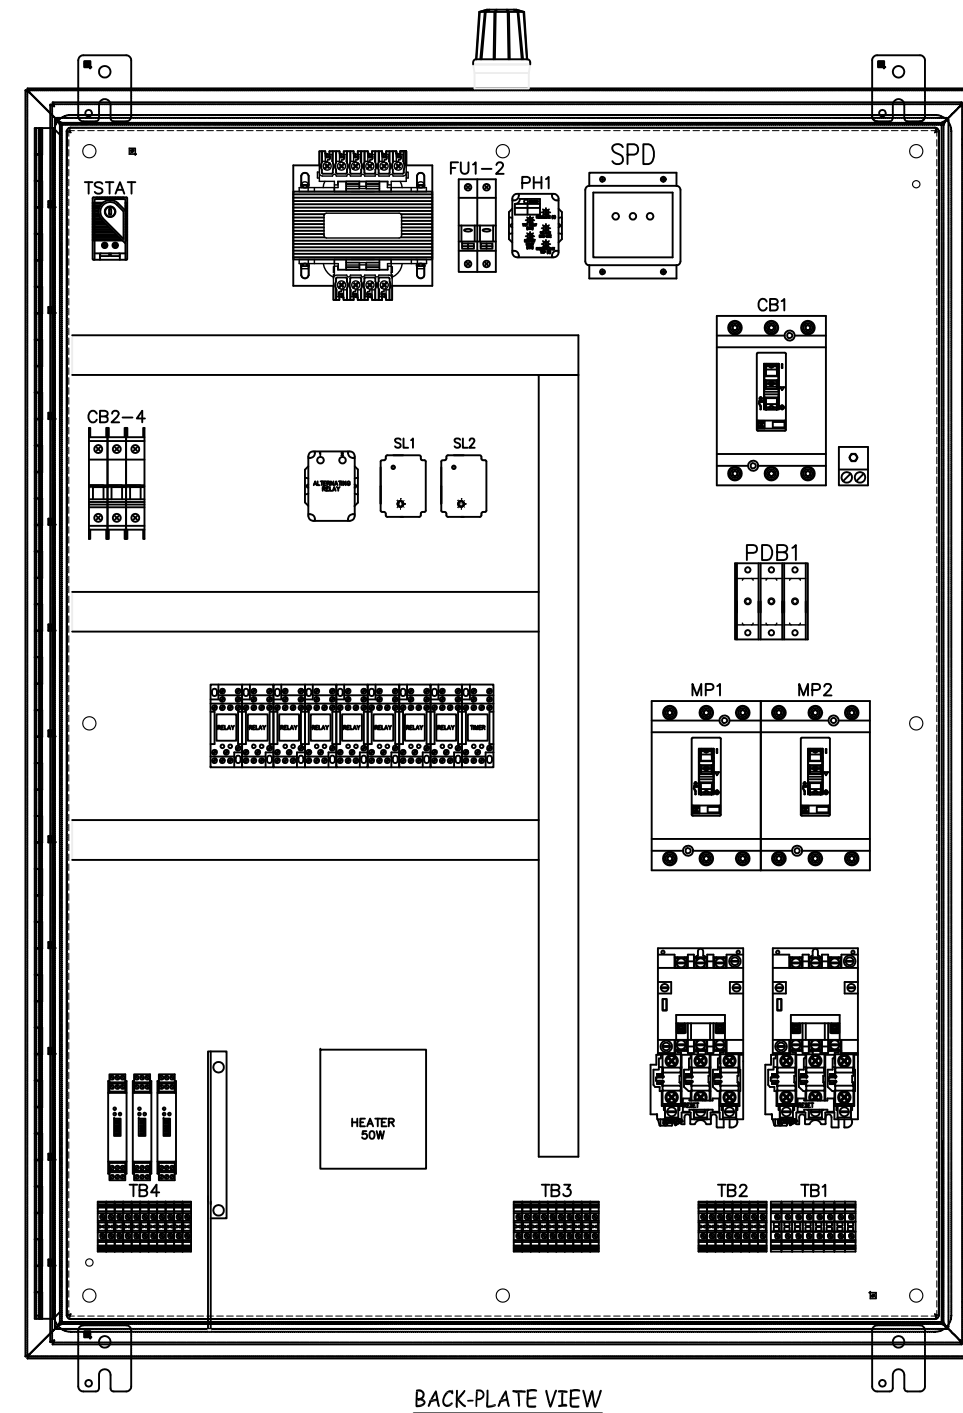

BACK-PLATE VIEW

THIS DRAWING CONTAINS PROPRIETARY INFORMATION WHICH MUST NOT BE DUPLICATED, USED, OR DISCLOSED IN WHOLE OR IN PART WITHOUT PRIOR WRITTEN CONSENT.

SHEET NUMBER
1 OF 1

NO.	REVISION HISTORY	DATE	BY



ROMTEC UTILITIES
NORTH BEND COTTAGE

DUPLEX PUMP CONTROL PANEL

DRAWN BY
SEL

DATE
3-16-18

PANEL REQUIREMENTS
SYM. 480 VAC
VOLTAGE PHASE 3 PHASE, 3-WIRE
FREQUENCY 60 Hz
SCCR 5 kA RMS SYM
TOTAL FLA 11.09 FLA
TYPE 4

LARGEST MOTOR POWER REQUIREMENTS
HP 1.5 HP
FLA 5.0 FLA

PROJECT NUMBER
5004040AL