1.04 **DESIGN CRITERIA FORM**



Romtec Utilities has designed this Scope of Supply and Design Submittal based on the following information provided by:

Project Name:

Information here in provided by:

Arroyo Burro Park Hanly Engineering

DESIGN CRITERIA

Project Site Address:

CAD site plan available at this time?


Final Project Owner and/or Operator:

Governing Sewer or Water Authority:

Does Authority have a lift station standard? Does this project require "Buy America" materials?


Source of Water:

Water Type:

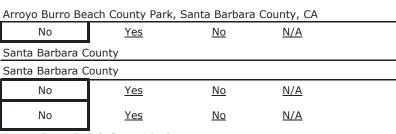

Arroyo Burro Beach County Park

Wastewater

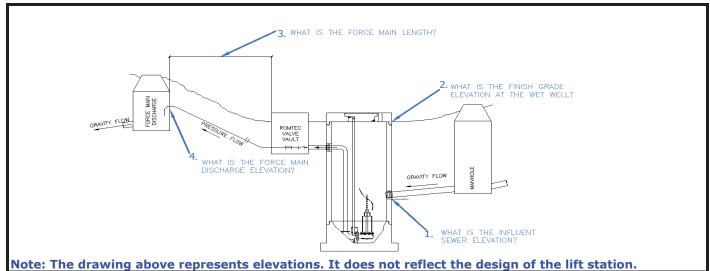

Peak design inflow (max flow to lift station):

Pumping Rate:

1. Influent sewer elevation:

2. Finish grade elevation at wet well:

3. Force main length:

4. Force main discharge elevation:

Force main diameter:

Force main material (PVC, DI, etc.):

Is the lift station a classified space?

Unknown_gpm

60 gpm at 20 ft. Total Dynamic Head

Yes

No

12 ft.

16.67 ft.

180 ft.

16 ft.

4 in. inside dia.

PVC

Force Main is:	Existing	<u>New</u>	<u>Existing</u>	
Force Main Discharge (manhole, pressure force m	Unknown			
Standby generator:	N/A	<u>Permanent</u>	<u>Portable</u>	<u>N/A</u>
Generator fuel:		<u>Diesel</u>	Natural Gas	
Power Supply:	208V	<u>480V</u>	<u>240V</u>	<u>208V</u>
Power Supply:	Single-phase	Three-Phase	Single-phase	

No