

1.04 DESIGN CRITERIA FORM

Romtec Utilities has designed this Scope of Supply and Design Submittal based on the following information provided by:

Project Name: Settler's Field
 Information here in provided by: Team 4 Engineering
 Name: _____
 Email Address: _____
 Telephone: _____

DESIGN CRITERIA

Project Site Address: Kitsap County, Washington
 CAD site plan available at this time?

Yes	Yes	No	N/A
-----	-----	----	-----


 Final Project Owner and/or Operator: Kitsap County Public Works
 Governing Sewer or Water Authority: Kitsap County Public Works
 Does Authority have a lift station standard?

Yes	Yes	No	N/A
-----	-----	----	-----

 Does this project require "Buy America" materials?

No	Yes	No	N/A
----	-----	----	-----

 Source of Water: Development
 Water Type: Wastewater

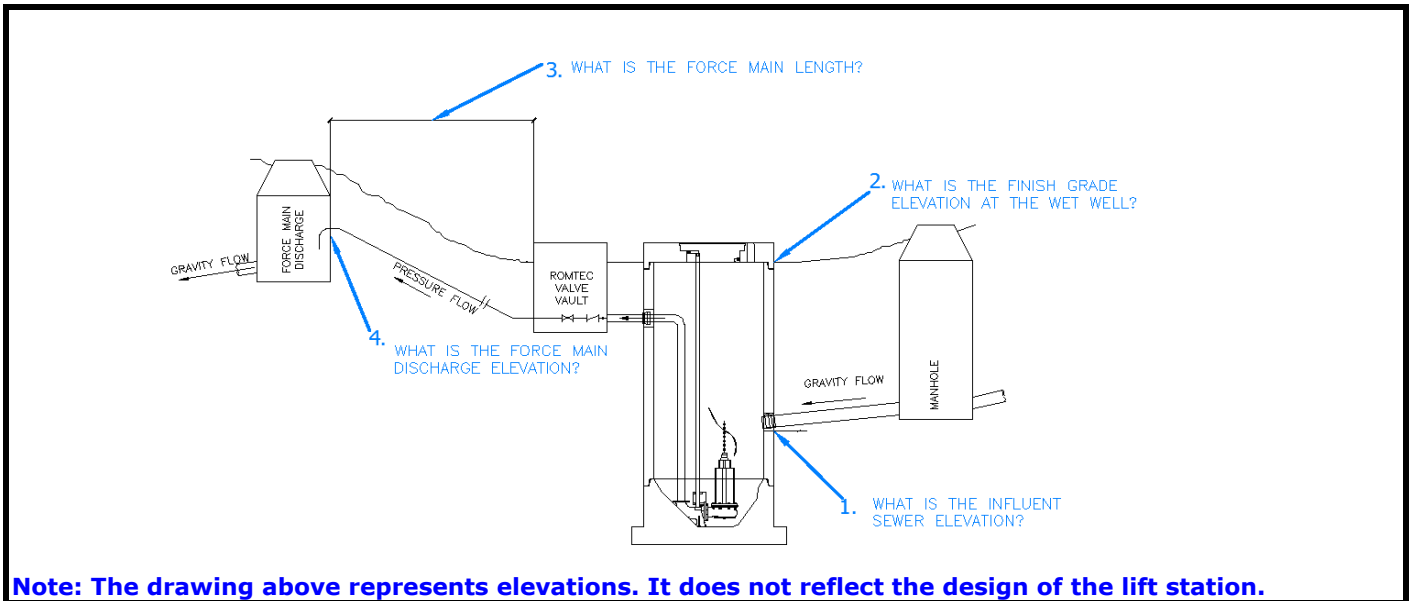

Note: The drawing above represents elevations. It does not reflect the design of the lift station.

Peak design inflow (max flow to lift station): 28.8 g.p.m.
 Pumping Rate: 130 g.p.m. (**GREATER THAN PEAK DESIGN INFLOW**)

1. Influent sewer elevation: 47.65 ft.
2. Finish grade elevation at wet well: 53.5 ft.
3. Force main length: 1032 ft.
4. Force main discharge elevation: 73.59 ft.

Force main diameter: 4 in. inside dia.
 Force main material (PVC, DI, etc.): HDPE SDR11

Force Main is:

New	New	Existing
-----	-----	----------

 Force Main Discharge (manhole, pressure force main, etc.) Unknown

Standby generator:

Permanent	Permanent	Portable	N/A
-----------	-----------	----------	-----

 Generator fuel:

Natural Gas	Diesel	Natural Gas	
-------------	--------	-------------	--

 Power Supply:

480V	480V	240V	208V
------	------	------	------

 Power Supply:

Three-Phase	Three-Phase	Single-phase	
-------------	-------------	--------------	--

 Is the lift station a classified space?

Yes	Yes	No
-----	-----	----