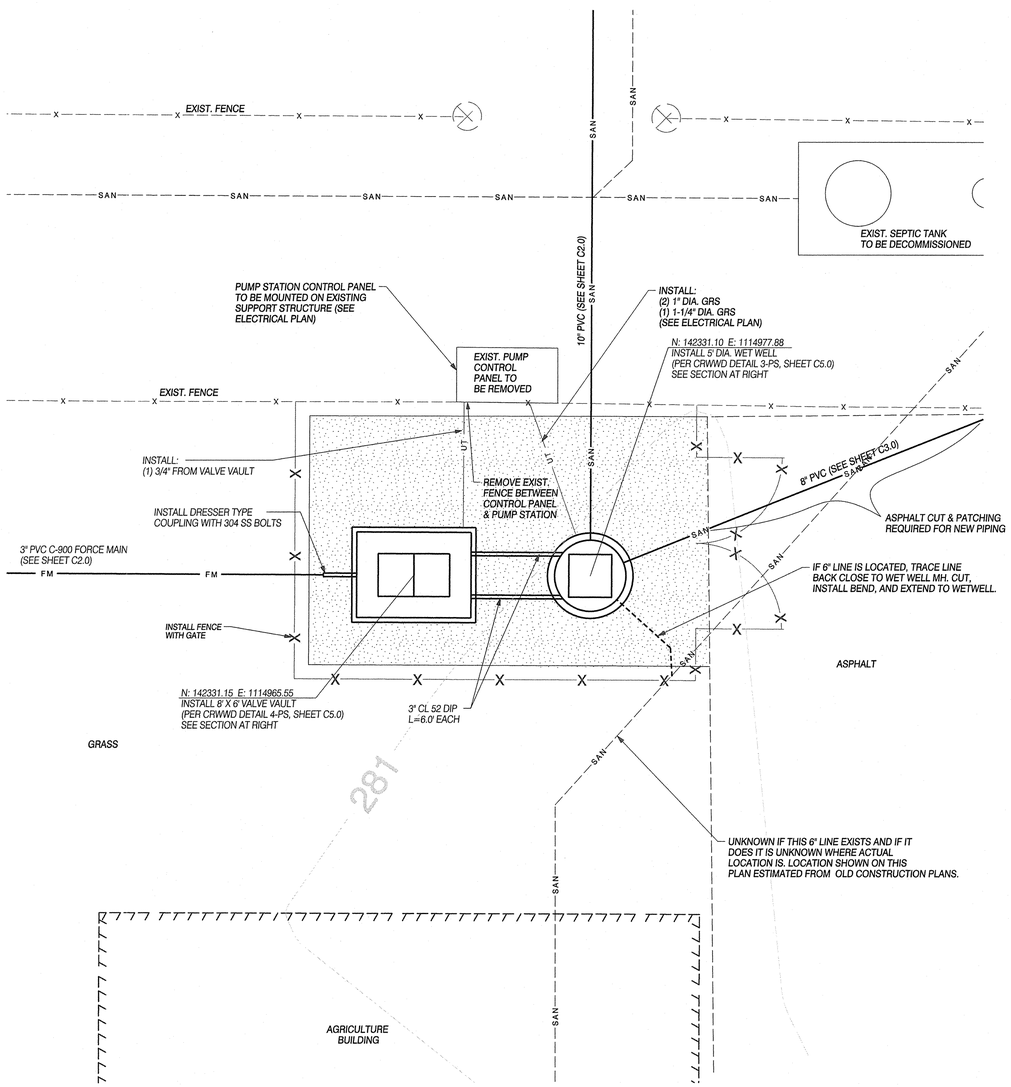

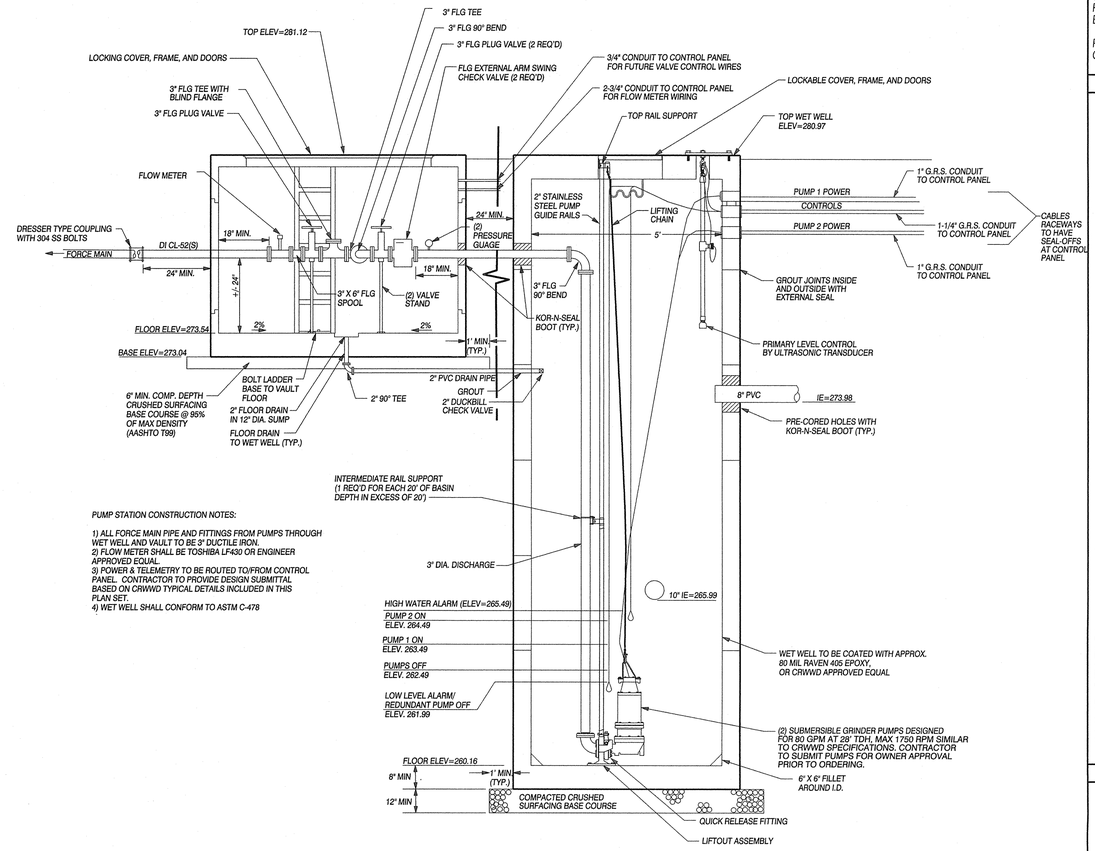

PUMP STATION CONSTRUCTION NOTES:

1) ALL FORCE MAIN PIPE AND FITTINGS FROM PUMPS THROUGH WET WELL AND VAULT TO BE 3" DUCTILE IRON.
2) FLOW METER SHALL BE TOSHIBA LF430 OR ENGINEER APPROVED EQUAL.
3) POWER & TELEMETRY TO BE ROUTED TO/FROM CONTROL PANEL. CONTRACTOR TO PROVIDE DESIGN SUBMITTAL BASED ON CRWWD TYPICAL DETAILS INCLUDED IN THIS PLAN SET.
4) WET WELL SHALL CONFORM TO ASTM C-478

WET WELL/VALVE VAULT SECTION

SCALE: 1" = 3'

NOTES:

1) SEE SHEETS C5.0 AND C5.1 FOR CRWWD STANDARD CONSTRUCTION DRAWINGS.
2) SEE ELECTRICAL FOR INTRINSIC INSTALLATION REQUIREMENTS.

3" MIN. AC PAVEMENT OVER 6" MIN. CRUSHED BASE COURSE.

SCALE: 1"=5'

-5 0 5 10

Bid Set
Date 6-23-10

CLIENT:

BATTLE GROUND
SCHOOL DISTRICT
PO BOX 200
BATTLE GROUND, WA 98604

PH: (360) 887-6677
CONTACT: KEVIN JOLMA

PUMP STATION PLAN FOR:

PRAIRIE HIGH SCHOOL SANITARY IMPROVEMENTS AND PUMP STATION

OLSON ENGINEERING INC.
LAND SURVEYORS
ENGINEERS
1111 BROADWAY, VANCOUVER, WA 98660
360-695-1385
503-289-9939

PETER A. TUCK
STATE OF WASHINGTON
31817
REGISTERED PROFESSIONAL ENGINEER
PRELIMINARY

JUN 23 2010

CHANGES / REVISIONS

DESCRIPTION:	DATE:

DESIGNED: JJW

DRAWN: JJW

CHECKED: PAT

DATE: MAY 2010

SCALE: H: 1"=5'
V:

COPYRIGHT 2010, OLSON ENGINEERING, INC.

PRAIRIE HIGH SCHOOL SANITARY IMPROVEMENTS AND PUMP STATION

JOB NO. 8578.01.01

SHEET

C3.0

J:\data\8000\8500\8570\8578\Engineering\8578.e.C3.0.pump.sta.plan.dgn
M:\MicroStation V8\pen tables\sanitary.tbl