

# PRELIMINARY SITE LAYOUT

BASED ON SITE PLANS RECEIVED 12-27-18

WET WELL DEPTH: 15.5'

DISTANCE TO TERMINATION: 40' (MAX)

NOTE: CABLES TO BE TERMINATED IN APPROVED JUNCTION BOX OR CONTROL PANEL.

APPROX. CABLE LENGTH NEEDED: 65'


PUMP CABLE LENGTH: 75'

TRANSDUCER CABLE LENGTH: N/A

FLOAT CABLE LENGTH: 65'

NOTE: SITE MATERIALS, DESIGN INFORMATION, AND SERVICES **NOT** SUPPLIED BY ROMTEC UTILITIES:

- GRADING
- WIRING AND CONDUIT
- FENCING AND PAVING
- SITE LIGHTING
- SITE UTILITIES (WATER, POWER, ETC)
- SCADA ANTENNA
- ALL ON-SITE INSTALLATION

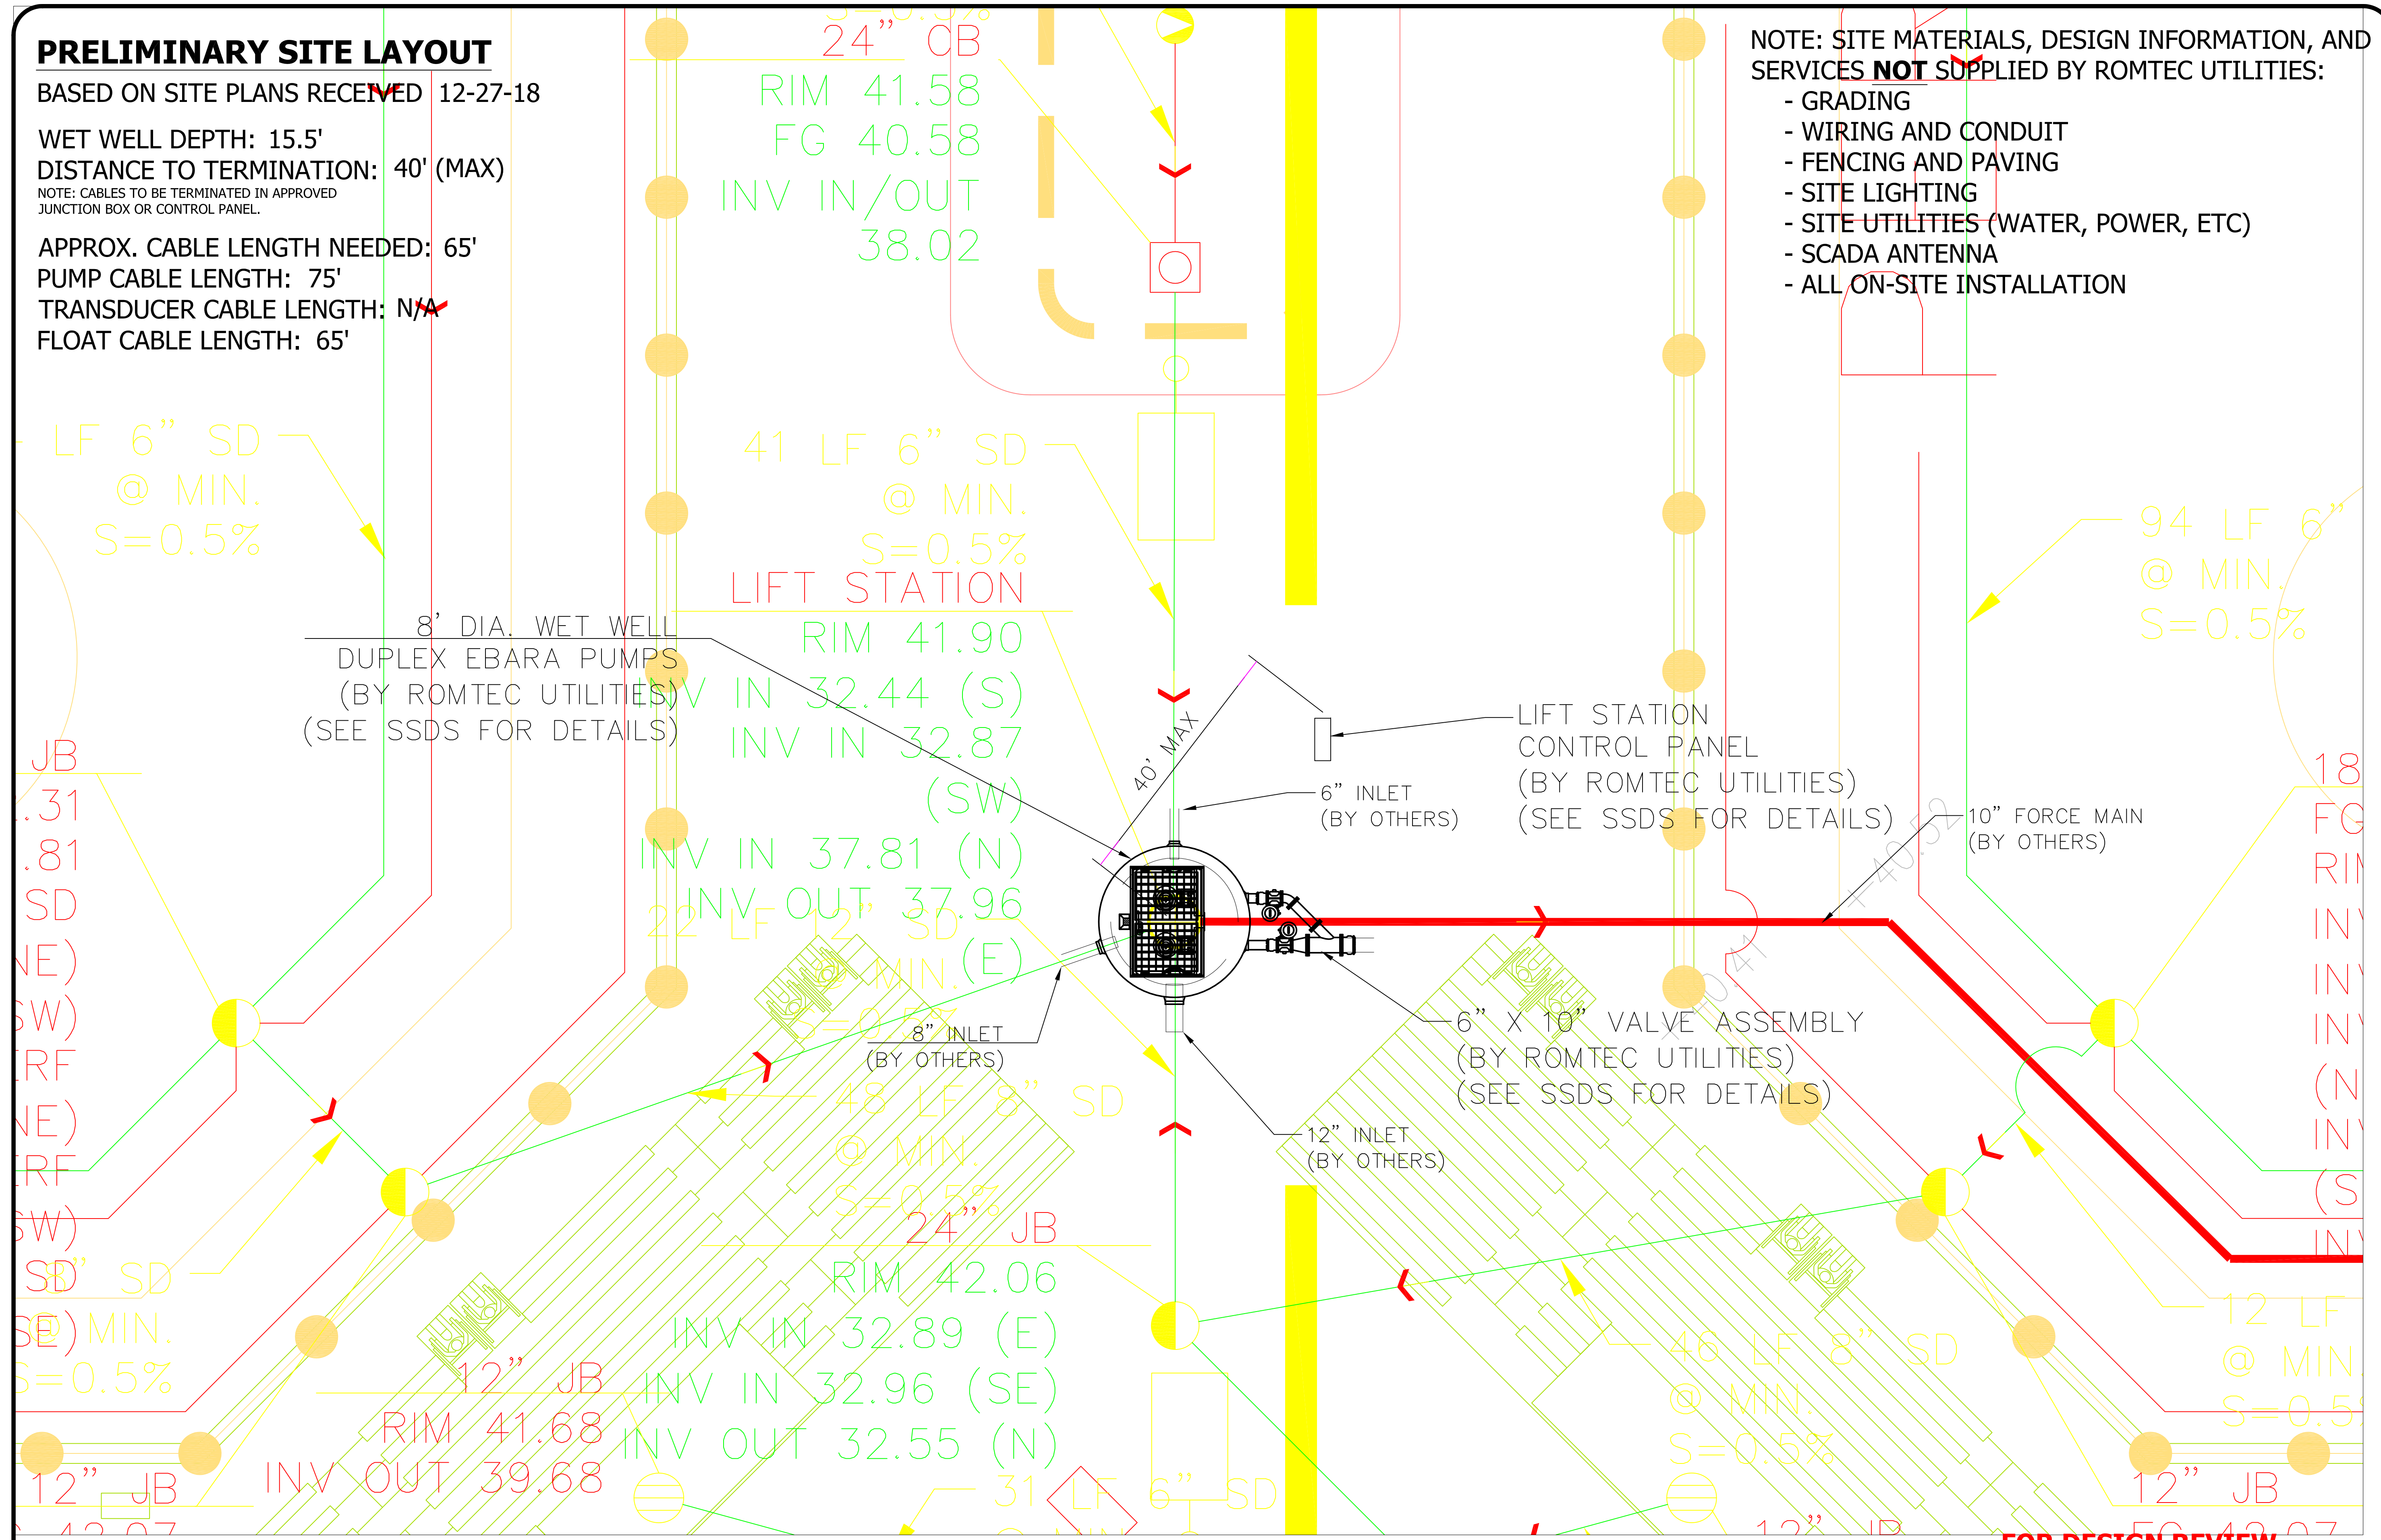

© 2018 ROMTEC INC. ALL RIGHTS RESERVED. THESE PLANS AND DRAWINGS MAY NOT BE REPRODUCED, ADAPTED, OR FURTHER DISTRIBUTED, AND NO COMPONENTS MAY BE CONSTRUCTED FROM THESE PLANS, WITHOUT WRITTEN PERMISSION OF ROMTEC, INC.

**FOR DESIGN REVIEW**

VERIFY SCALE DRAWING SHALL BE IN ACCORDANCE WITH ALL APPLICABLE CODES AND REGULATIONS. THIS SHEET IS NOT TO BE REPRODUCED OR COPIED WITHOUT THE WRITTEN PERMISSION OF ROMTEC UTILITIES, INC.	DATE: 8-1-18
	REVISION HISTORY
DSN: KEVIN BOGAN DRN: KEVIN BOGAN CKD:	1 1-10-19 1 11-6-18
18240 NORTH BANK ROAD ROSEBURG, OREGON 97470 PHONE: (541) 496-9678 WWW.ROMTECUTILITIES.COM	NEW SITE PLAN RECEIVED, NEW BEACH SIZE NEW ELEVATIONS AND INLETS, PER NEW PLANS
ARMY DEPOT PARK SACRAMENTO STATE UNIVERSITY PRELIMINARY SITE LAYOUT LAYOUT DRAWING	MECHANICAL SHEET 2 OF 2