


2.01 SITE LAYOUT

8ft DIAMETER WET WELL
 6in DISCHARGE PIPING
 FLYGT NP PUMPS
 6in 687 VALVE VAULT
FOR DESIGN REVIEW

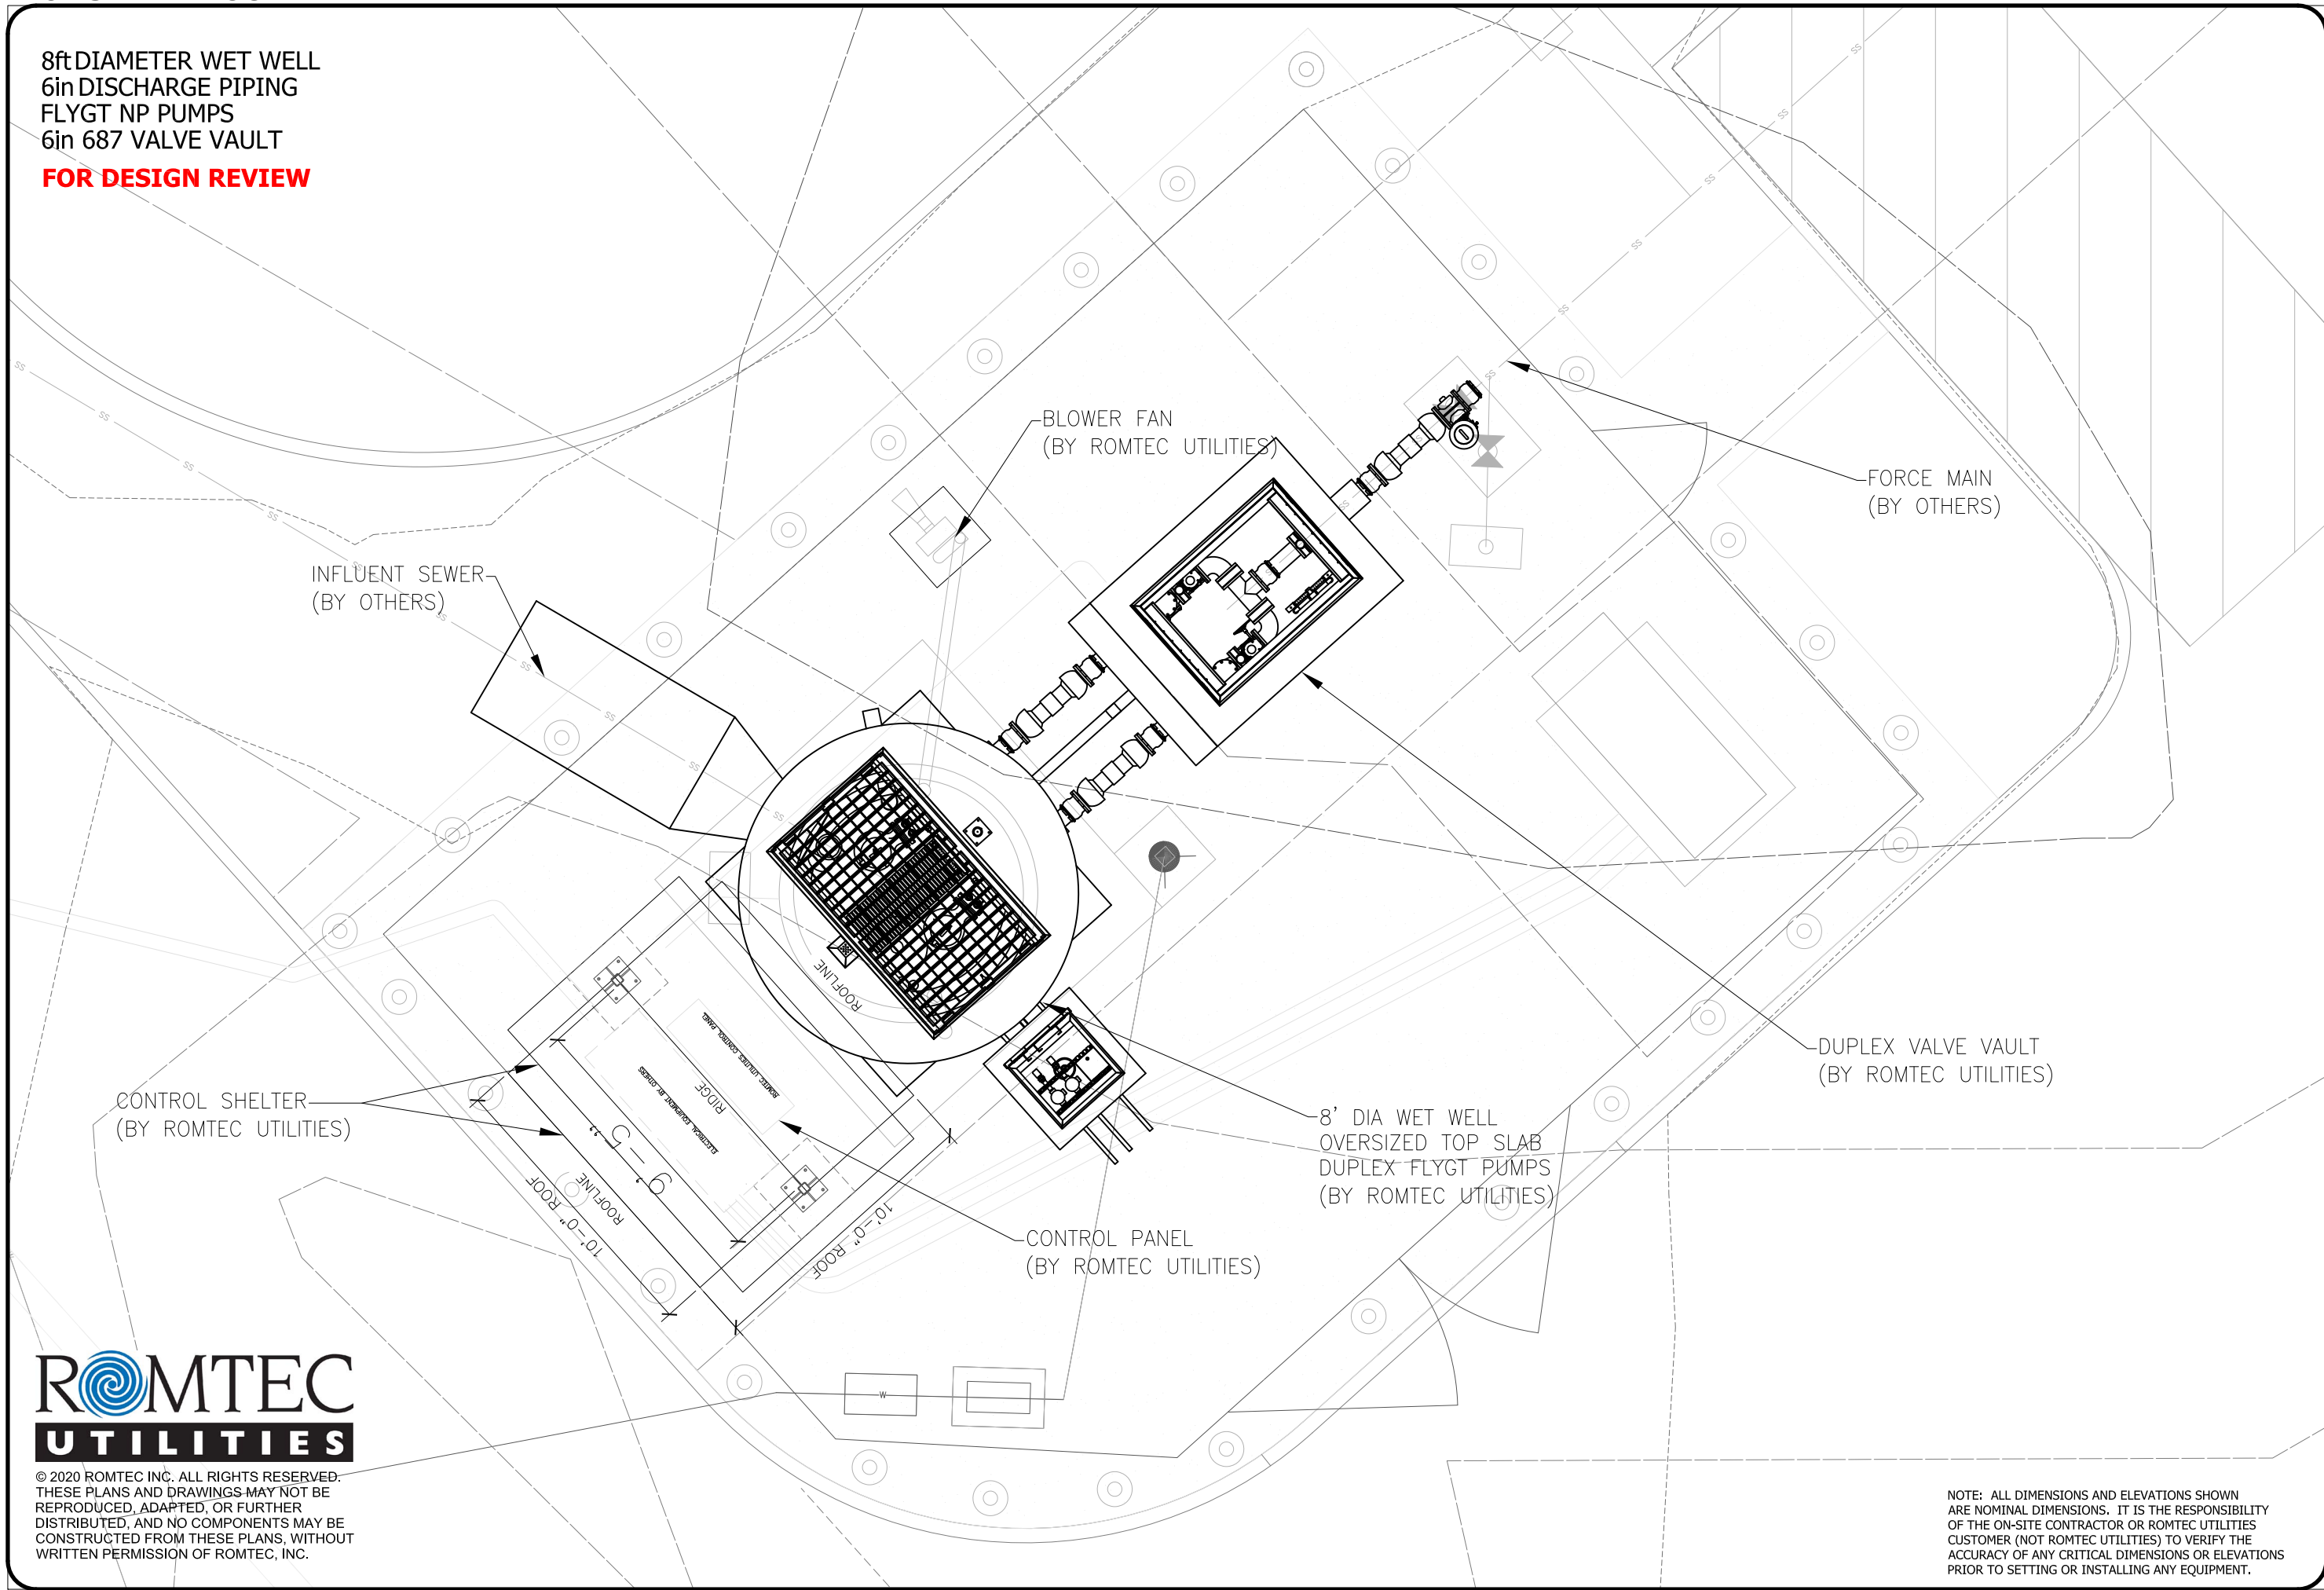

© 2020 ROMTEC INC. ALL RIGHTS RESERVED.
 THESE PLANS AND DRAWINGS MAY NOT BE
 REPRODUCED, ADAPTED, OR FURTHER
 DISTRIBUTED, AND NO COMPONENTS MAY BE
 CONSTRUCTED FROM THESE PLANS, WITHOUT
 WRITTEN PERMISSION OF ROMTEC, INC.

NOTE: ALL DIMENSIONS AND ELEVATIONS SHOWN
 ARE NOMINAL DIMENSIONS. IT IS THE RESPONSIBILITY
 OF THE ON-SITE CONTRACTOR OR ROMTEC UTILITIES
 CUSTOMER (NOT ROMTEC UTILITIES) TO VERIFY THE
 ACCURACY OF ANY CRITICAL DIMENSIONS OR ELEVATIONS
 PRIOR TO SETTING OR INSTALLING ANY EQUIPMENT.

REV	DATE	DESCRIPTION	BY
2	12/4/2020	REVISED PER COMMENTS	KB
1	11-4-20	REVISED DROP PIPE ASSEMBLY	AD

VERIFY SCALE	1" = 1'
DSIN: AD	DATE: 5-12-20
DRIN: AD	
CKD: KB	

ROMTEC UTILITIES
 18240 NORTH BANK ROAD
 ROSEBURG, OREGON 97470
 PHONE: (541) 496-9678
 WWW.ROMTECUTILITIES.COM

DERMODY TUKWILA DWAZ
 TUKWILA, WA
 WASTEWATER PUMP STATION
 LAYOUT DRAWING