

**PROJECT INFO**

Job Name:	Eagle Ridge Apartments
Company:	Sheldon Development INC.
Contact:	Carey Sheldon
Job Type:	New Station
Water Type/Source:	Wastewater (Sewage)
Import/Domestic:	Import Acceptable



**PACKAGE/STARTUP**

Offering:	Complete System
Mechanical:	All by Romtec Utilities
Pumps:	By Romtec Utilities
Control Panel:	By Romtec Utilities
Generator:	N/A
Advisor/Startup:	Mechanical & Electrical

**DESIGN CRITERIA**

**FLOW RATE**

Peak Inflow:	57	GPM
Pumping Rate:	105	GPM (of single pump)
Static Head:	15.8	Feet
TDH:	30.9	Feet
TDH Calcs:	RU Calcs	

**ACTIVE VOLUME**

Max Pump Starts:	10.00	Starts/Hr
Cycle Time:	6.00	Minutes
Active Volume:	157.50	Gallons
Active Volume:	21.06	Cu Feet
Well Shape:	Round	
Well Diameter:	5	Feet
Well Dimensions:	N/A	N/A
Cross-Section Area:	19.63	Sq Feet
Min. Depth Required:	1.07	Feet
Active Depth:	1.10	Feet

**STORAGE VOLUME (if required)**

Time:		Minutes
Flow Rate:		GPM
Volume:	0.00	Gallons
Volume:	0.00	Cu. Feet
Min. Depth Required:	0.00	Feet
Storage Depth:		Feet

**ON-SITE POWER**


Power:	480V / 3-Phase
--------	----------------

**FORCE MAIN**

FM Info:	New	Single FM
Length:	418.5	Feet
FM Discharge:	338.35	Feet
FM High Point:	338.35	Feet
Nominal ID:	3"	(1) (2) (3)
Type/Rating:	PVC SCH40	

**INFLUENT PIPING**

Influent Invert:	329.8	330.6	(3)
Influent Size:	8"	4"	
Type:			

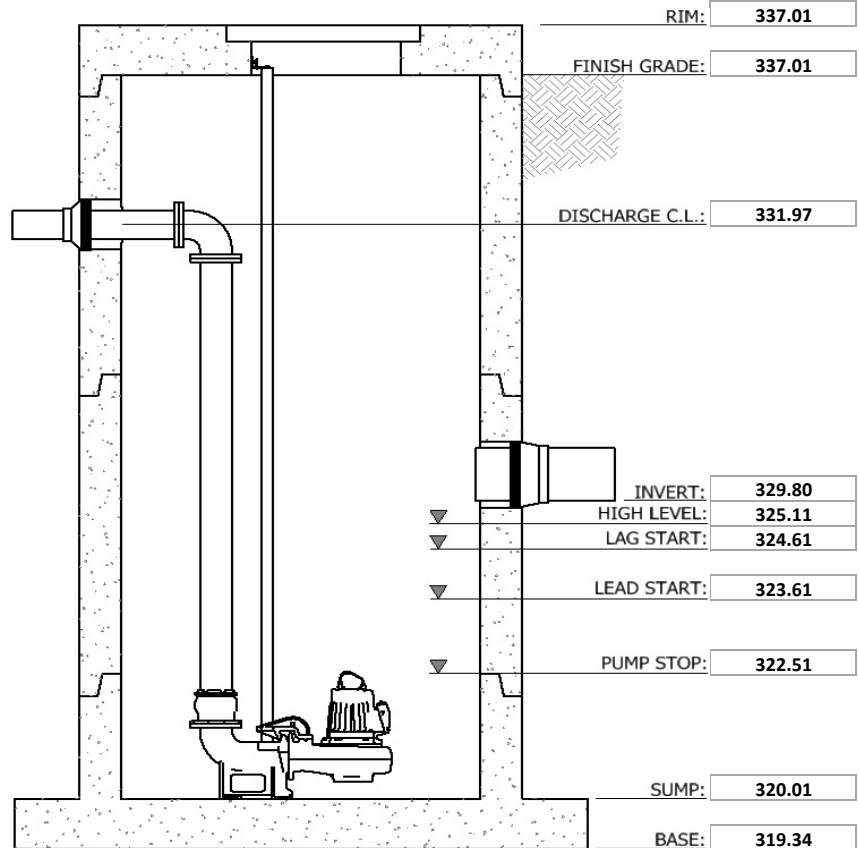

Note: Image is a preliminary representation of the pumping system. Elevations shown are the primary factors used for sizing the wet well. Backup levels not shown. Additional (or fewer) level settings may be required.