


EXAMPLE ONLY!! - TYPICAL FIELD WIRING INTERCONNECTS FROM CONTROL PANEL TO WET WELL - EXAMPLE ONLY!!
 ACTUAL FIELD WIRING MY VARY FOR YOUR PANEL. CONSULT SUBMITTAL WIRING PRINTS.
 THESE DRAWINGS ARE A RECOMMENDATION ONLY. ALL STATE AND LOCAL CODES SUPERCEDE THESE SUGGESTIONS.

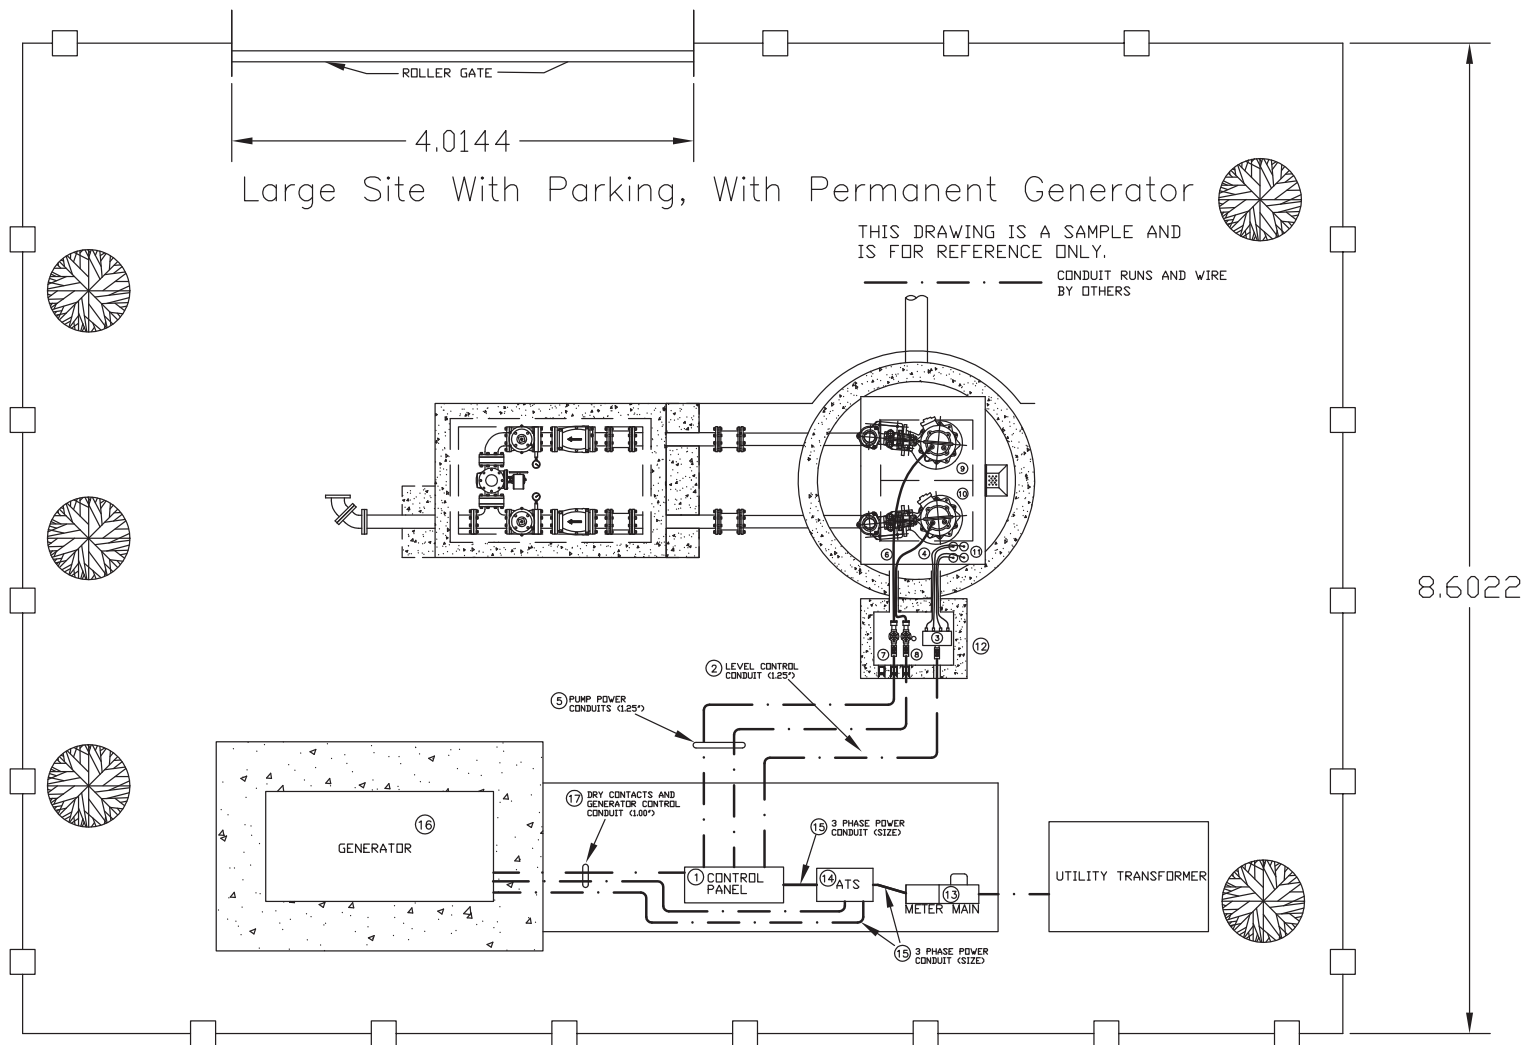

THIS DRAWING IS A SAMPLE AND
 IS FOR REFERENCE ONLY.

CONDUIT RUNS AND WIRE
 BY OTHERS

- 3- STAINLESS STEEL JUNCTION CAN SUPPLIED BY ROMTEC UTILITIES.
- 4- WET WELL LEVEL SENSING CABLES.
- 6- SOW SUBMERSIBLE PUMP CORDS SUPPLIED ON PUMP.
- 7 & 8- GUAC EXPLOSION BOXES, SEAL-OFFS, CABLE SEAL PROVIDED BY ROMTEC UTILITIES
- 9- SUBMERSIBLE PUMP 1
- 10- SUBMERSIBLE PUMP 2
- 11- WET WELL LEVEL SENSORS
- 12- CONCRETE JUNCTION BOX SUPPLIED BY ROMTEC UTILITIES

EXAMPLE SITE WIRING TO AID IN SITE ELECTRICAL WORK	CONCRETE JUNCTION BOX COMPONENT VIEW AND CONDUIT RUNS	ROMTEC UTILITIES 18240 NORTH BANK ROAD ROSELBURG, OR 97470 (503) 496-3541 FAX (503) 496-0803 WWW.romtecutilities.com	UL LISTED LIFT STATION CONTROL PANEL & PUMP DISCONNECT PANEL-DUPLEX PUMPS WITH OPTIONAL PERMANENT ON-SITE ELECTRICAL GENERATOR.	USAL SW DRIL SW CIO. SW	BY DATE 4-9-09	DESCRIPTION REV
			SHEET 3 OF 3 JOB NUMBER			