





ARC ARMOR SIZE-1
WHITE STAINLESS STEEL ENCLOSURE
(FRONT VIEW)

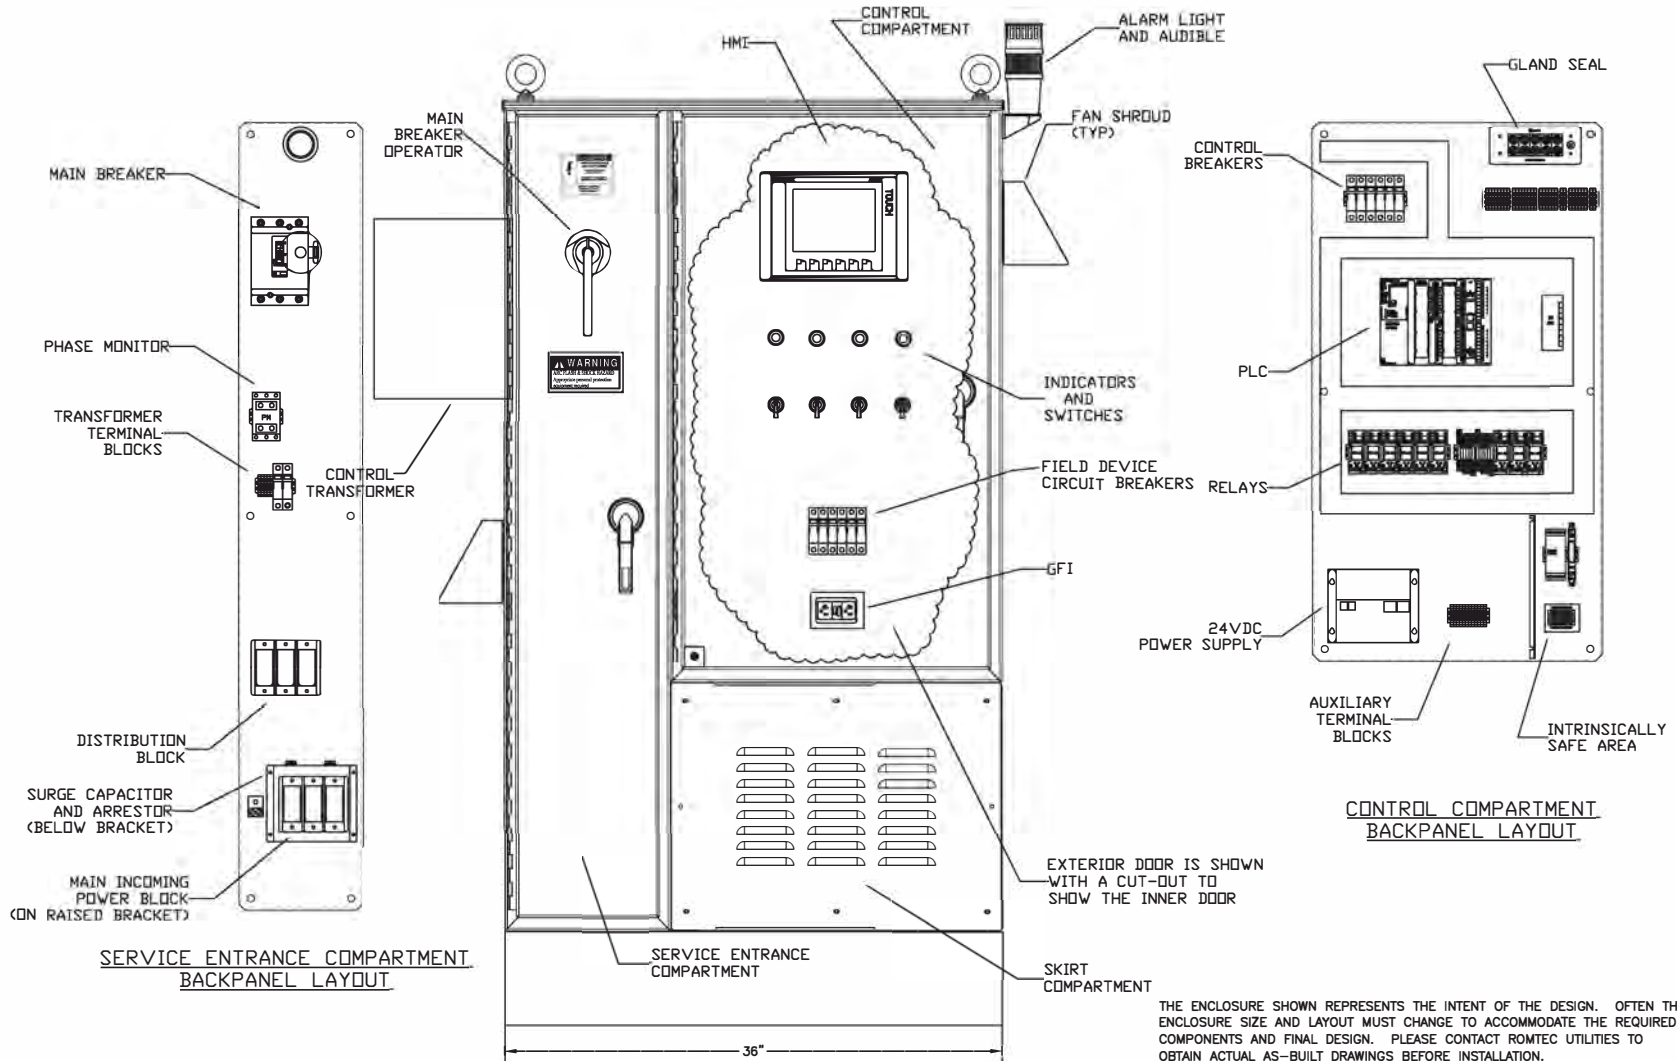

THE ENCLOSURE SHOWN REPRESENTS THE INTENT OF THE DESIGN. OFTEN THE ENCLOSURE SIZE AND LAYOUT MUST CHANGE TO ACCOMMODATE THE REQUIRED COMPONENTS AND FINAL DESIGN. PLEASE CONTACT ROMTEC UTILITIES TO OBTAIN ACTUAL AS-BUILT DRAWINGS BEFORE INSTALLATION.

| | | | | | | | | |
|---|------------|---------------|-------------------------------|-------------------------|------|----------------------|--------------|-----------|
| VOLTAGE: 460 VAC | PHASE: 3 Ø | HERTZ: 60 HZ. | TOTAL F.L.A.: 53.75 FLA | ENCLOSURE TYPE: NEMA 3R | REV. | REVISION DESCRIPTION | DATE | DRWN. |
| LARGEST MOTOR: HP: 7.5HP | F.L.A.: | 11FLA | SHORT CIRCUIT CURRENT: kA RMS | SYMMETRICAL, V MAX. | | | | |
| Notes: | | | | | | | DRWN. | DATE |
| 1) Level Switches Must Be Rated A Minimum Of 2 Amps @ 120 Volts | | | | | | | REC | 1/20/11 |
| 2) Torque 1/2" Field Terminals To 20 In. Lbs. 3/8" To 20 In. Lbs. | | | | | | | KAS | 4/10/13 |
| 3) Field Wiring Must Be 60°C Copper Wire Minimum. | | | | | | | | |
| 4) ----- = Items Not Supplied In Panel | | | | | | | | |
| | | | | | | | SHEET 1 OF 2 | DRWG. NO. |
| | | | | | | | | BAE |

ARC ARMOR SIZE-1
WHITE STAINLESS STEEL ENCLOSURE
(BACK VIEW)

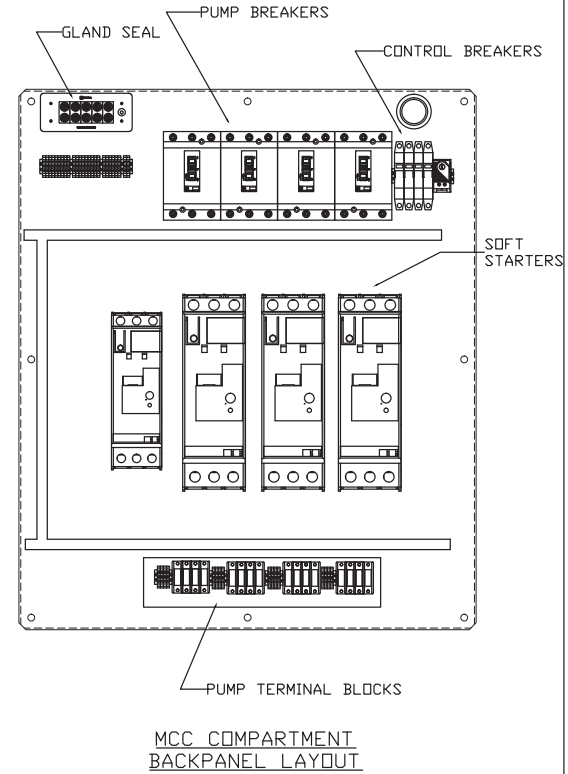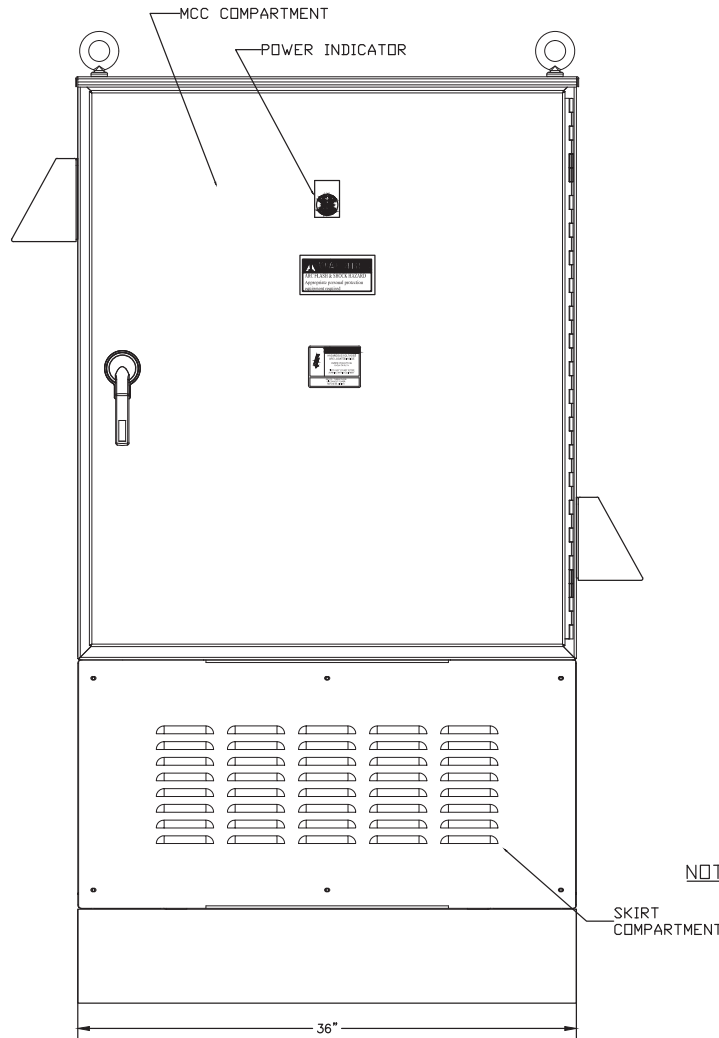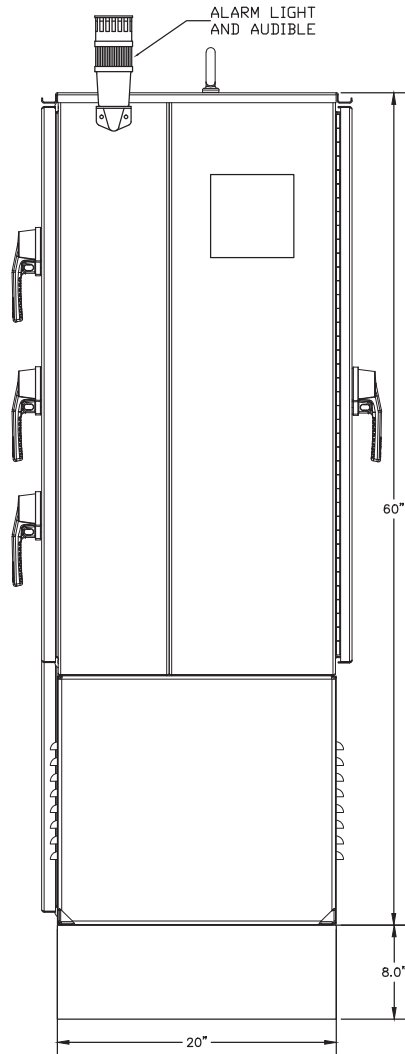

NOTE: MCC COMPARTMENT INTERLOCKED WITH MAIN CIRCUIT BREAKER COMPARTMENT

THE ENCLOSURE SHOWN REPRESENTS THE INTENT OF THE DESIGN. OFTEN THE ENCLOSURE SIZE AND LAYOUT MUST CHANGE TO ACCOMMODATE THE REQUIRED COMPONENTS AND FINAL DESIGN. PLEASE CONTACT ROMTEC UTILITIES TO OBTAIN ACTUAL AS-BUILT DRAWINGS BEFORE INSTALLATION.

| | | | | | | | | |
|---|------------|---------------|-------------------------|-------------------------------|------|----------------------|---------|--------------|
| VOLTAGE: 460 VAC | PHASE: 3 Ø | HERTZ: 60 HZ. | TOTAL F.L.A.: 53.75 FLA | ENCLOSURE TYPE: NEMA 3R | REV. | REVISION DESCRIPTION | DATE | DRWN. |
| LARGEST MOTOR; HP: | 7.5HP | F.L.A.: | 11 FLA | SHORT CIRCUIT CURRENT: kA RMS | | | | |
| Notes: 1) Level Switches Must Be Rated A Minimum Of 2 Amps @ 120 Volts 2) Torque 1/2" Field Terminals To 20 In.Lbs. 3/8" To 20 In.Lbs. 3) Field Wiring Must Be 60°C Copper Wire Minimum. 4) ----- = Items Not Supplied In Panel | | | | | | DRWN. | DATE | SHEET 2 OF 2 |
| | | | | | | REC | 1/20/11 | DRWG. NO. |
| | | | | | | KAS | 4/10/13 | BAE |