


ANCHOR BOLT LAYOUT
THIS IS A REFERENCE DRAWING.
ELBOWS MUST BE FIELD VERIFIED SO THEY
ARE PLUMB WITH THE DISCHARGE PIPE ELBOW.




© 2011 ROMTEC INC. ALL RIGHTS RESERVED. THESE
PLANS AND DRAWINGS MAY NOT BE REPRODUCED,
ADAPTED, OR FURTHER DISTRIBUTED, AND NO
COMPONENTS MAY BE CONSTRUCTED FROM THESE
PLANS, WITHOUT WRITTEN PERMISSION OF ROMTEC, INC.

NOTE: VALVE YOKE IS SHOWN
FOR REFERENCE ONLY.

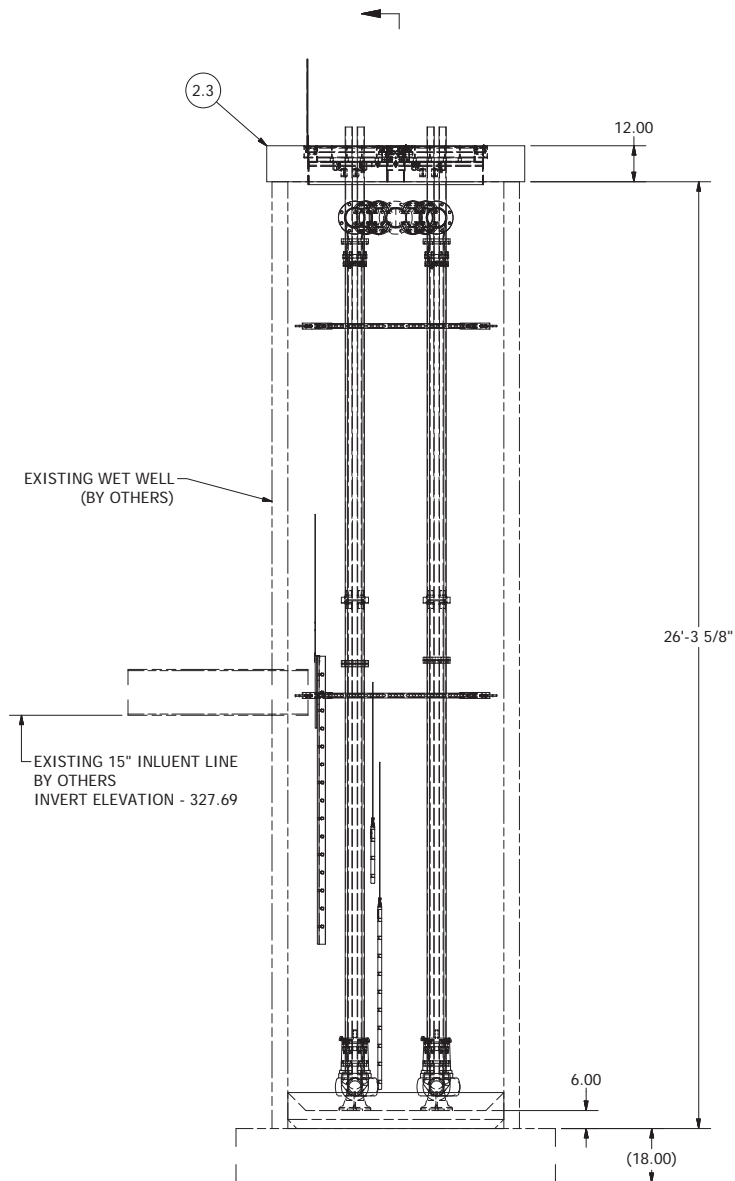

NOTE: WET WELL TOP SLAB IS PEDESTRIAN RATED

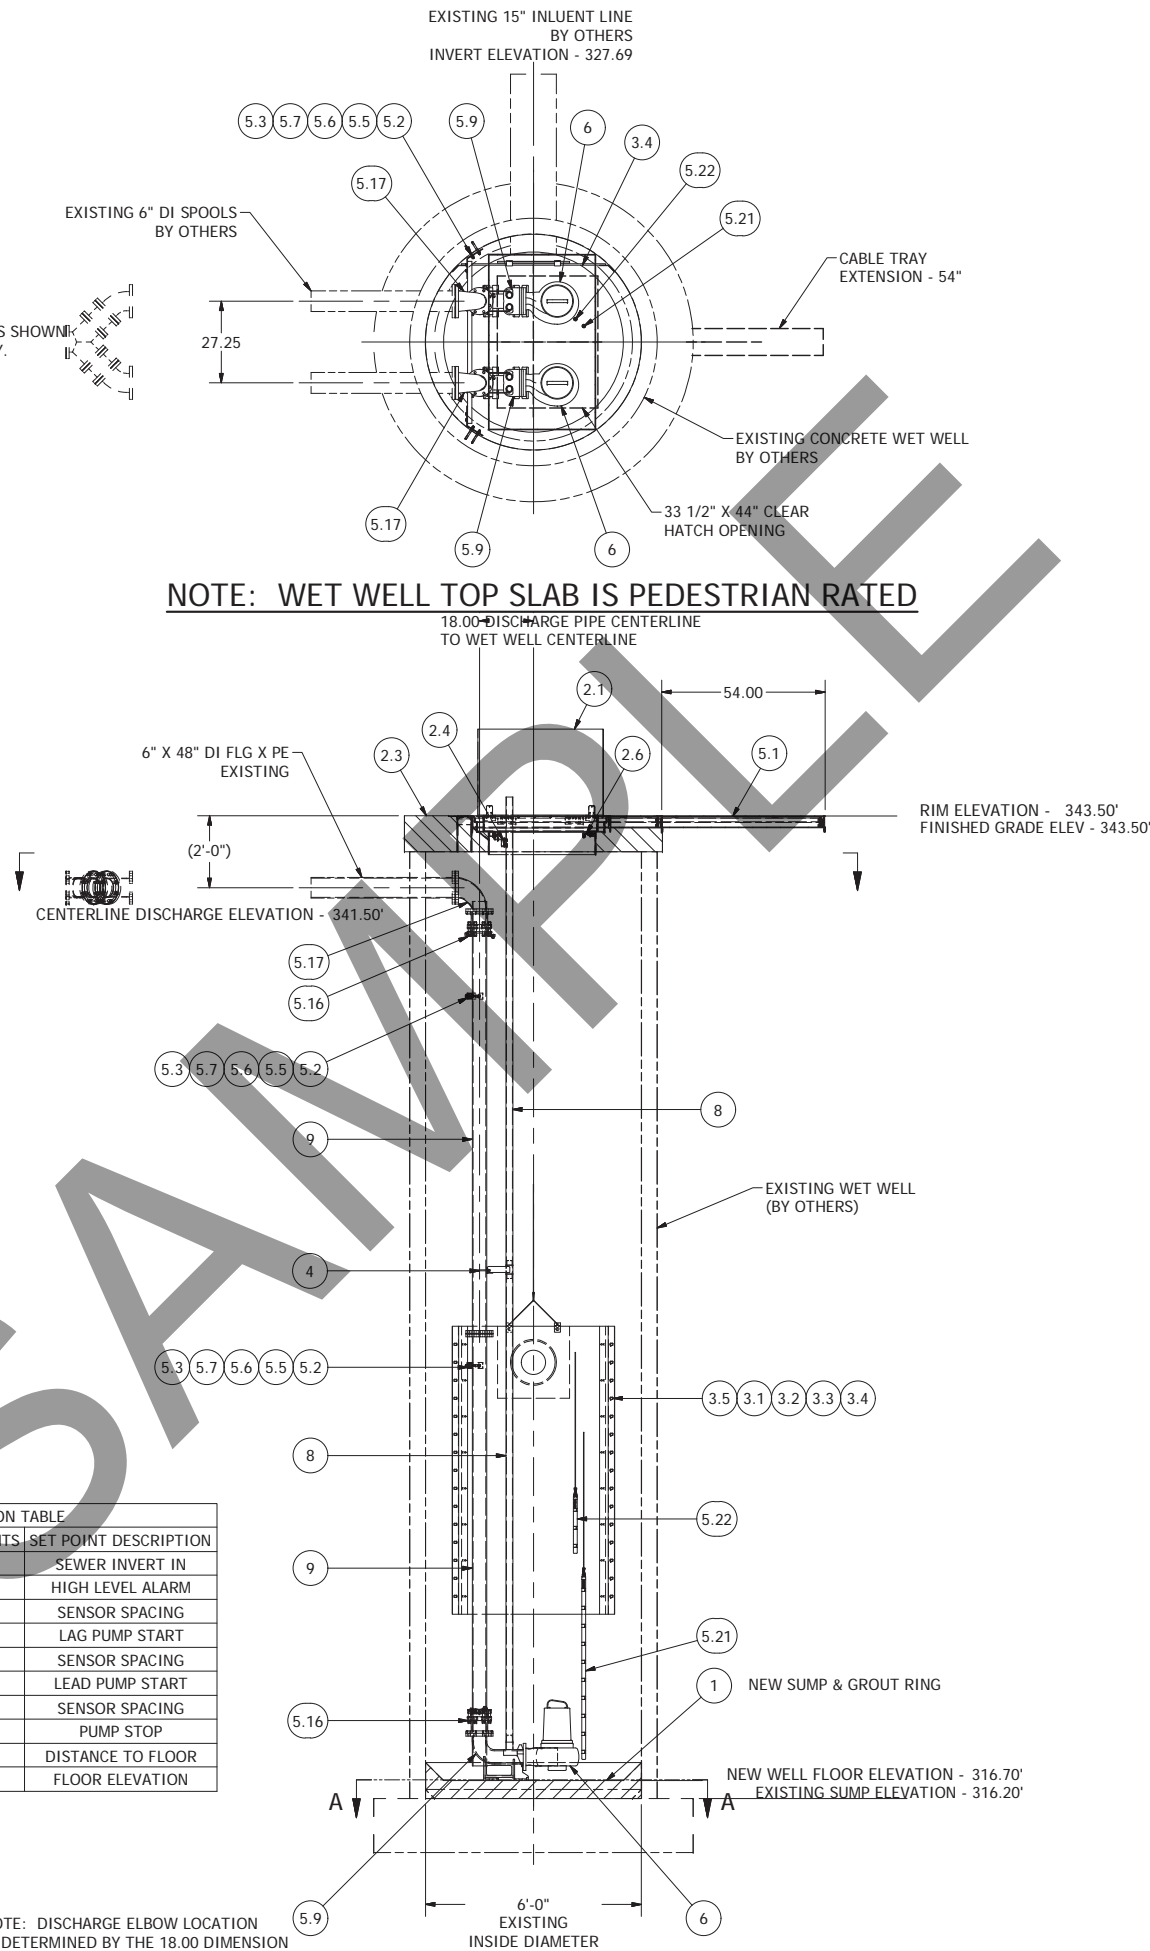

NOTE: ALL DIMENSIONS AND ELEVATIONS SHOWN
ARE NOMINAL DIMENSIONS. IT IS THE RESPONSIBILITY
OF THE ON-SITE CONTRACTOR OR ROMTEC UTILITIES
CUSTOMER (NOT ROMTEC UTILITIES) TO VERIFY THE
ACCURACY OF ANY CRITICAL DIMENSIONS OR ELEVATIONS
PRIOR TO SETTING OR INSTALLING ANY EQUIPMENT.

6' DIAMETER WET WELL 4" & 6" DISCHARGE PIPING NP3102 FLYGT PUMPS WITH EXISTING VALVE VAULT

ALL MATERIALS SHOWN ON THIS SHEET WILL BE
SUPPLIED BY ROMTEC UTILITIES AND DELIVERED TO
THE SITE AFTER THE HOLE HAS BEEN EXCAVATED
AND SHORED. THE CONTRACTOR SHALL SUPPLY A
CRANE OF SUFFICIENT SIZE TO LOWER ALL THE
CONCRETE PIECES INTO THE HOLE SAFELY. THE
THE CONTRACTOR SHALL INSTALL THE WET WELL
(AND VALVE VAULT AND METERING VAULT IF
APPLICABLE). ROMTEC UTILITIES WILL PROVIDE A
REPRESENTATIVE FOR TECHNICAL ASSISTANCE ON
THE DAY OF INSTALLATION TO ANSWER ANY QUESTIONS
THAT MAY ARISE. THE CONTRACTOR IS RESPONSIBLE
FOR ALL PLUMBING AND ELECTRICAL CONNECTIONS
AND INSTALLATION. ITEMS NOTED AS "BY OTHERS"
WILL BE PROVIDED AND INSTALLED BY THE CONTRACTOR.
ROMTEC UTILITIES WILL NOT INSTALL ANY OF THE
COMPONENTS SHOWN ON THIS PAGE.

DRAWING GEOMETRY
SHALL BE MAINTAINED
AND NOT BE
FIT TO THE SHEET
DO NOT SCALE
THIS DRAWING

COMPONENT DRAWING

**ROMTEC
UTILITIES**
18240 NORTH BANK ROAD
ROSEBURG, OREGON 97470
(541) 496-9678
FAX (541) 496-0804

MARK LIFT STATION RETROFIT 4" - 6' DIA WET WELL

SHEET
1 OF 1

JOB NUMBER
RMTC
0000

REV	DESCRIPTION	DATE	APPROV
1	COMPONENT DRAWING	06/15/11	AM
2	CHANGED NEW SLAB THICKNESS	6/21/11	AD
3	ADDED CABLE TRAY EXTENSION - NEW	07/22/11	AM
4	UPDATE FOR LAUNCH.DOCX	8/10/11	AD
5	UPDATED TOP SLAB	8/19/11	AD

REVISION HISTORY