


ISO VIEW  
SCALE 1 / 40

5' DIAMETER WET WELL  
4" DISCHARGE PIPING  
EBARA 80DVCFMU PUMPS  
4" 577 VALVE VAULT

NOTE:  
CONDUIT TO CONTROL PANEL (BY OTHERS)  
MINIMUM:  
(2) FOR POWER  
(1) FOR LEVEL SENSING


ALL MATERIALS SHOWN ON THIS SHEET WILL BE SUPPLIED BY ROMTEC UTILITIES AND DELIVERED TO THE SITE AFTER THE HOLE HAS BEEN EXCAVATED AND SHORED. THE CONTRACTOR SHALL SUPPLY A CRANE OF SUFFICIENT SIZE TO LOWER ALL THE CONCRETE PIECES INTO THE HOLE SAFELY. THE CONTRACTOR SHALL INSTALL THE WET WELL (AND VALVE VAULT AND METERING VAULT IF APPLICABLE). ROMTEC UTILITIES WILL PROVIDE A REPRESENTATIVE FOR TECHNICAL ASSISTANCE ON THE DAY OF INSTALLATION TO ANSWER ANY QUESTIONS THAT MAY ARISE. THE CONTRACTOR IS RESPONSIBLE FOR ALL PLUMBING AND ELECTRICAL CONNECTIONS AND INSTALLATION. ITEMS NOTED AS "BY OTHERS" WILL BE PROVIDED AND INSTALLED BY THE CONTRACTOR. ROMTEC UTILITIES WILL NOT INSTALL ANY OF THE COMPONENTS SHOWN ON THIS PAGE.

© 2016 ROMTEC INC. ALL RIGHTS RESERVED. THESE PLANS AND DRAWINGS MAY NOT BE REPRODUCED, ADAPTED, OR FURTHER DISTRIBUTED, AND NO COMPONENTS MAY BE CONSTRUCTED FROM THESE PLANS, WITHOUT WRITTEN PERMISSION OF ROMTEC, INC.

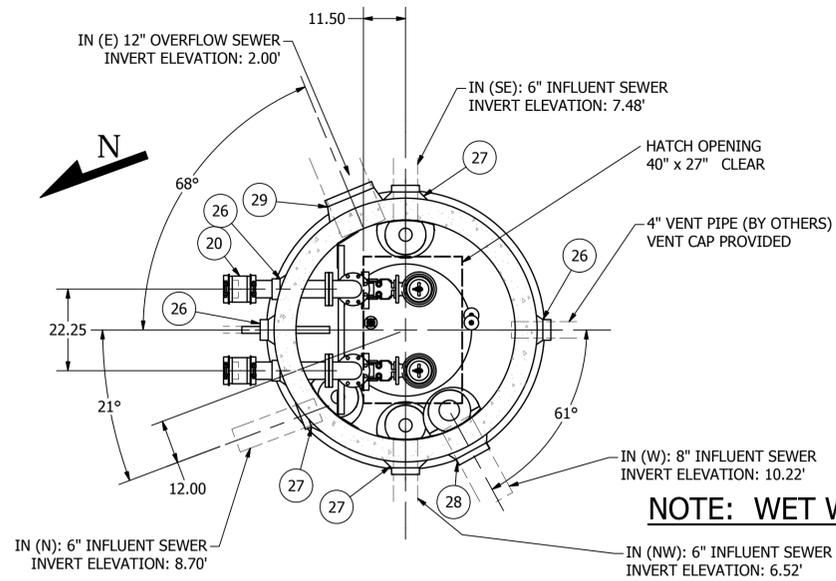

NOTE: WET WELL TOP SLAB IS H-20 OCCASIONAL TRAFFIC RATED

SECTION B-B  
SCALE 1 / 25

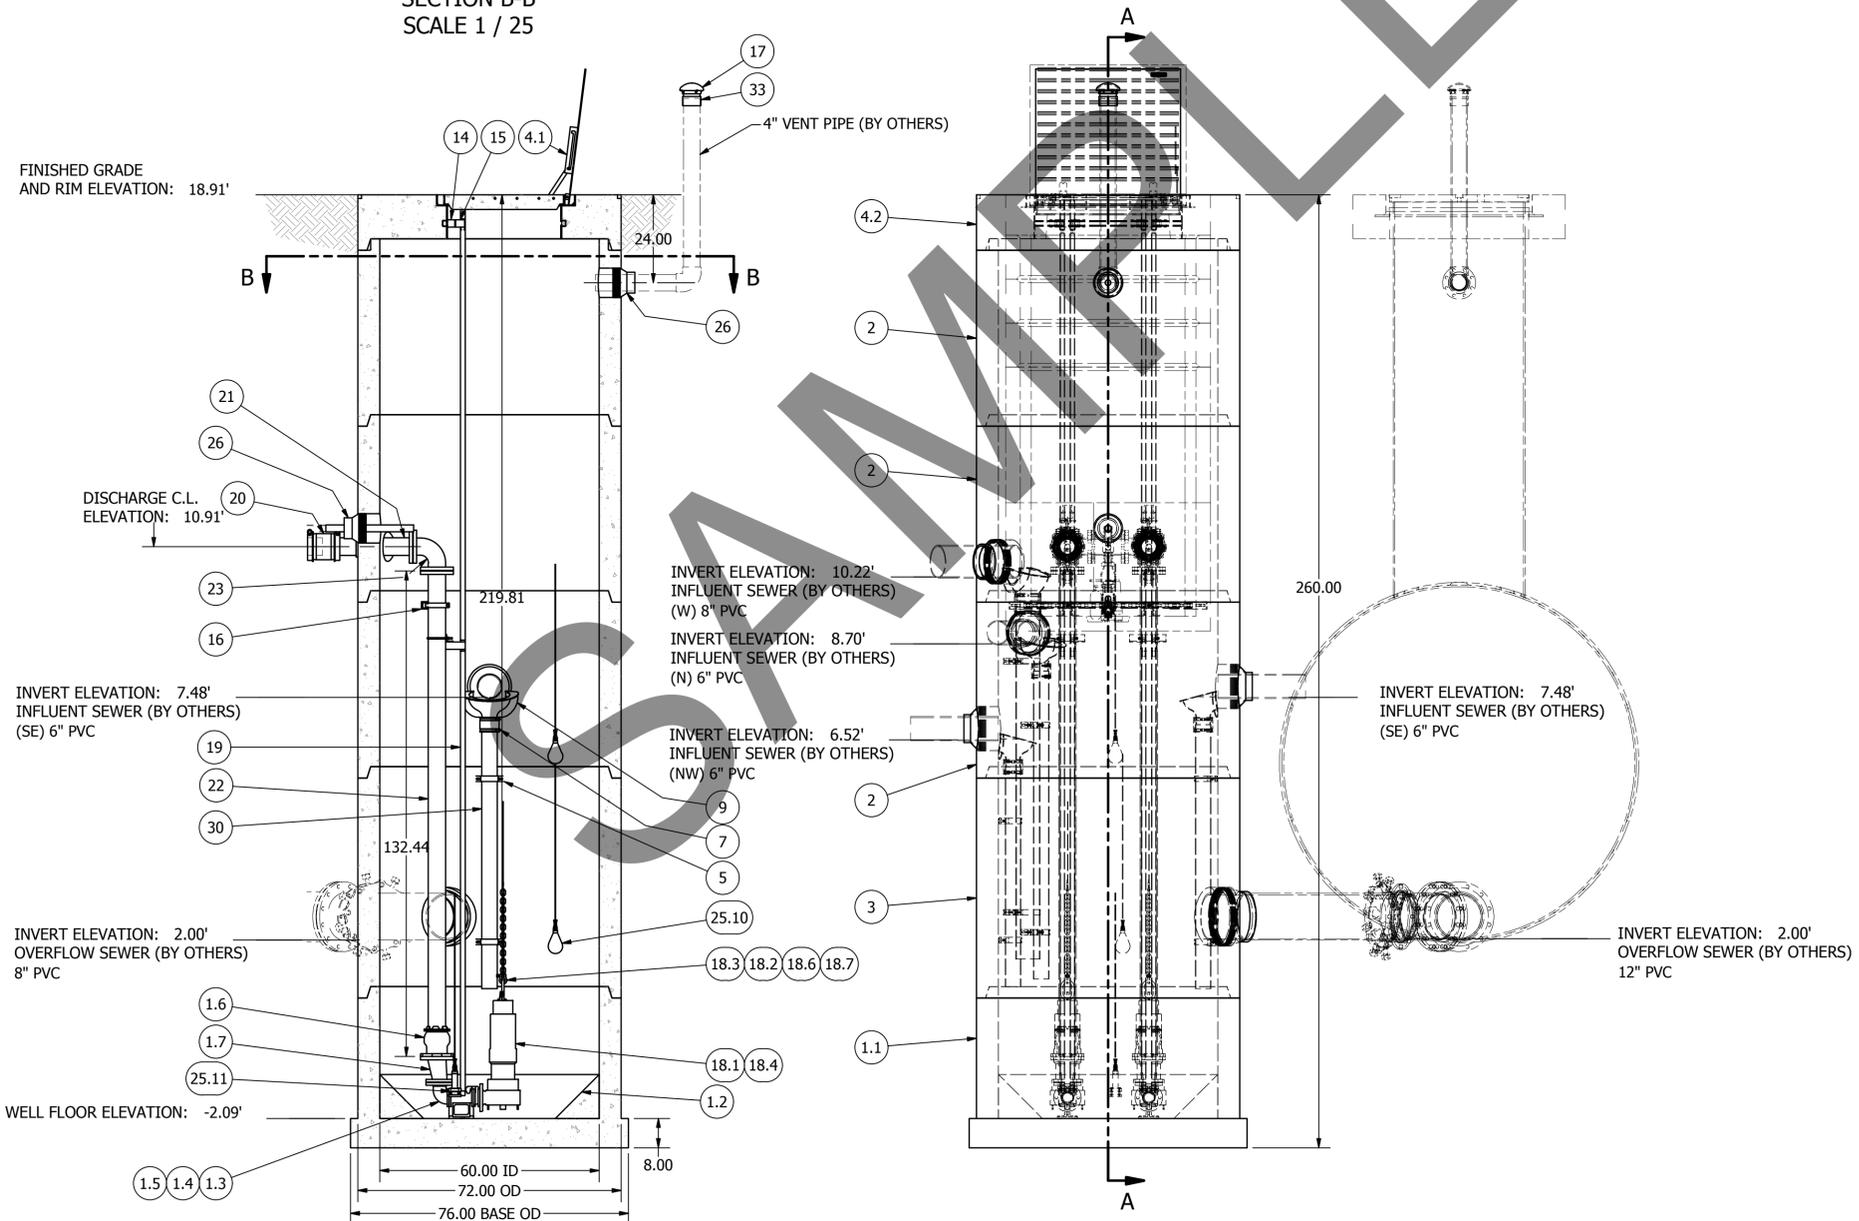

SECTION A-A  
SCALE 1 / 25

FRONT VIEW  
SCALE 1 / 25

NOTE: ALL DIMENSIONS AND ELEVATIONS SHOWN ARE NOMINAL DIMENSIONS. IT IS THE RESPONSIBILITY OF THE ON-SITE CONTRACTOR OR ROMTEC UTILITIES CUSTOMER (NOT ROMTEC UTILITIES) TO VERIFY THE ACCURACY OF ANY CRITICAL DIMENSIONS OR ELEVATIONS PRIOR TO SETTING OR INSTALLING ANY EQUIPMENT.

REV	DESCRIPTION	DATE	APPROV
1	REVISED PER 2-6-17 COMMENTS	2-28-17	AD
2	SHORTER DISCH PIPE, LAUNCH	3-16-17	KB

REVISION HISTORY

DATE	DATE
2-1-17	2-1-17

VERIFY SCALE  
BAR IS ONE INCH ON ORIGINAL DRAWING  
IF NOT ONE INCH ON SCALES ACCORDINGLY

DSN - KEVIN BOGAN  
DRN - KEVIN BOGAN  
CKD -  
DATE - 2-1-17


COMPONENT  
DRAWING

**ROMTEC UTILITIES**  
18240 NORTH BANK ROAD  
ROSEBURG, OREGON 97470  
(541) 496-9678  
FAX (541) 496-0804

TAPANEL, INC.  
USPS DISTRIBUTION CENTER  
WET WELL ASSEMBLY

SHEET  
1 OF 4

JOB NUMBER  
RMT  
0556

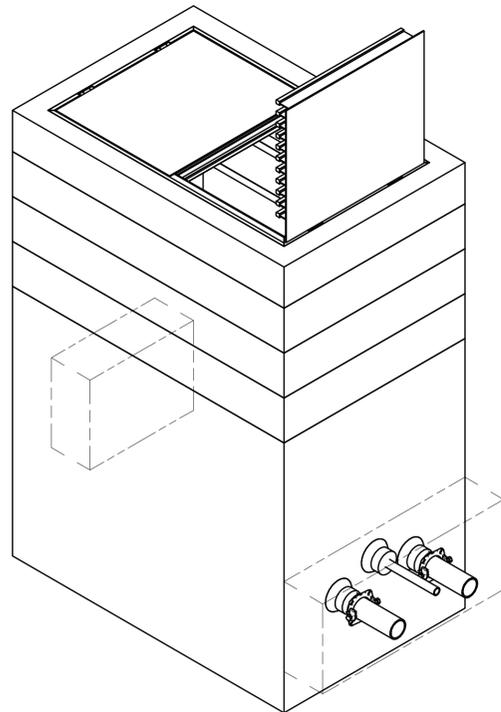


ISO VIEW  
SCALE 1 / 20  
**577 VALVE VAULT**  
**4" PIPING AND VALVES**  
**W/ SUMP PUMP**

PRECAST CONCRETE VAULT  
WITH EXTENSION(S)  
AS REQUIRED  
UTILITY VAULT MODEL 577

PRECAST LID WITH  
ALUMINUM VAULT HATCH


ALL MATERIALS SHOWN ON THIS SHEET WILL BE SUPPLIED BY ROMTEC UTILITIES AND DELIVERED TO THE SITE AFTER THE HOLE HAS BEEN EXCAVATED AND SHORED. THE CONTRACTOR SHALL SUPPLY A CRANE OF SUFFICIENT SIZE TO LOWER ALL THE CONCRETE PIECES INTO THE HOLE SAFELY. THE CONTRACTOR SHALL INSTALL THE WET WELL (AND VALVE VAULT AND METERING VAULT IF APPLICABLE). ROMTEC UTILITIES WILL PROVIDE A REPRESENTATIVE FOR TECHNICAL ASSISTANCE ON THE DAY OF INSTALLATION TO ANSWER ANY QUESTIONS THAT MAY ARISE. THE CONTRACTOR IS RESPONSIBLE FOR ALL PLUMBING AND ELECTRICAL CONNECTIONS AND INSTALLATION. ITEMS NOTED AS "BY OTHERS" WILL BE PROVIDED AND INSTALLED BY THE CONTRACTOR. ROMTEC UTILITIES WILL NOT INSTALL ANY OF THE COMPONENTS SHOWN ON THIS PAGE.

© 2016 ROMTEC INC. ALL RIGHTS RESERVED. THESE PLANS AND DRAWINGS MAY NOT BE REPRODUCED, ADAPTED, OR FURTHER DISTRIBUTED, AND NO COMPONENTS MAY BE CONSTRUCTED FROM THESE PLANS, WITHOUT WRITTEN PERMISSION OF ROMTEC, INC.

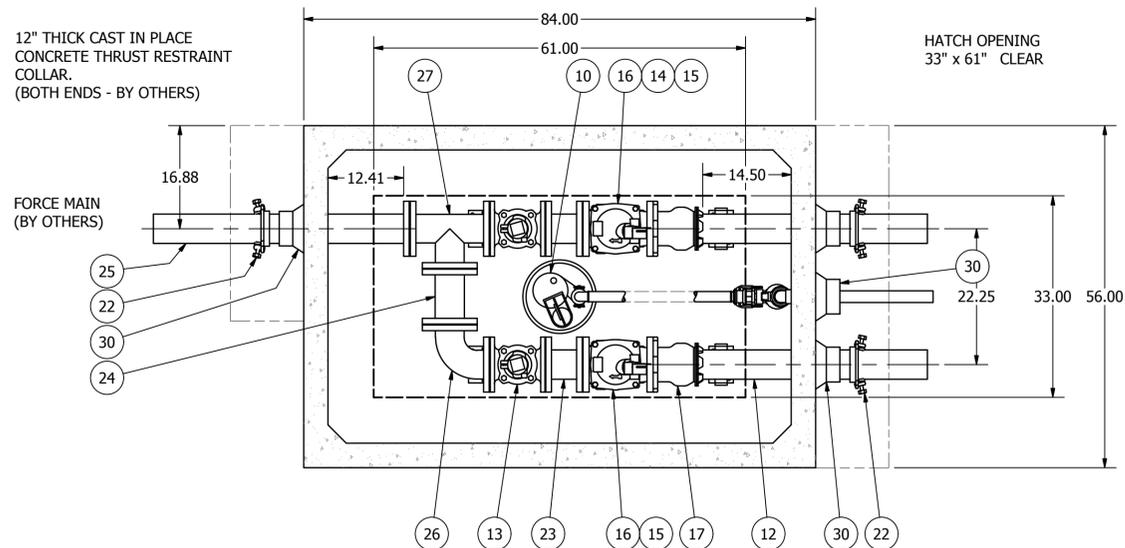


TOP VIEW  
SECTION E-E  
SCALE 1 / 15

NOTE: VAULT TOP SLAB IS H-20 OCCASIONAL RATED

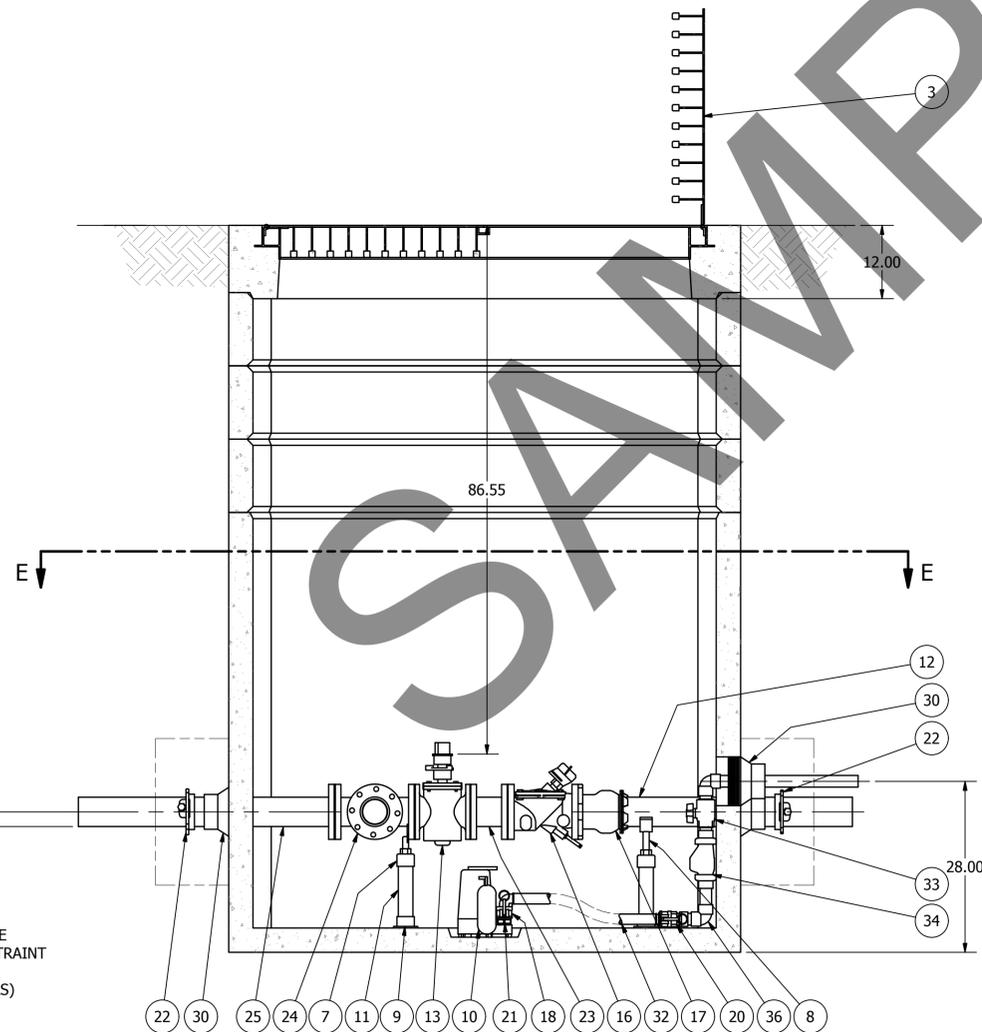

PROFILE VIEW  
SECTION D-D  
SCALE 1 / 15

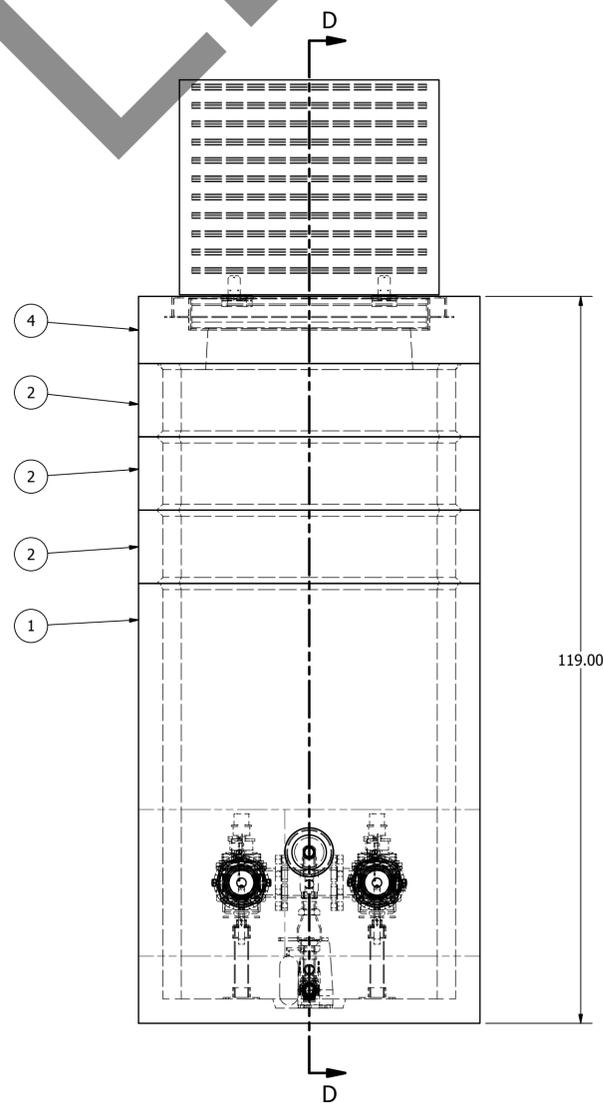

FRONT VIEW  
SCALE 1 / 15

NOTE: ALL DIMENSIONS AND ELEVATIONS SHOWN ARE NOMINAL DIMENSIONS. IT IS THE RESPONSIBILITY OF THE ON-SITE CONTRACTOR OR ROMTEC UTILITIES CUSTOMER (NOT ROMTEC UTILITIES) TO VERIFY THE ACCURACY OF ANY CRITICAL DIMENSIONS OR ELEVATIONS PRIOR TO SETTING OR INSTALLING ANY EQUIPMENT.

VERIFY SCALE BAR IS ONE INCH ON ORIGINAL DRAWING 0 1"		DSN - KEVIN BOGAN	3-16-17	KB
IF NOT ONE INCH ON SCALES ACCORDINGLY		DRN - KEVIN BOGAN	DATE	APPROV
ROMTEC UTILITIES 18240 NORTH BANK ROAD ROSEBURG, OREGON 97470 (541) 496-9678 FAX (541) 496-0804		REV	DESCRIPTION	REVISION HISTORY
USPS DISTRIBUTION CENTER VALVE VAULT ASSEMBLY		1		
TAPANI, INC.				
SHEET				
2 OF 4				
JOB NUMBER				
RMTC				
0556				