


PART 2: DESIGN DATA

If using assumed elevations, note this in Additional Information.

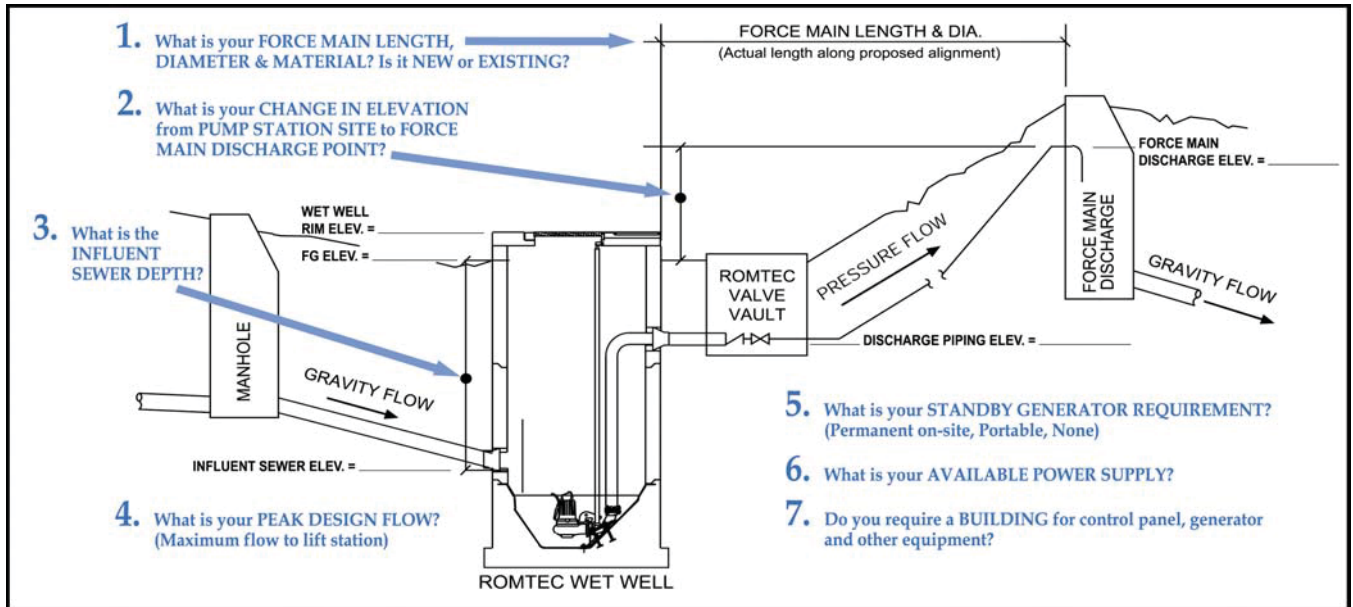

1. Force main length: _____ 50 ft. (actual length along proposed alignment)

Force main diameter (inside): _____ 6 in. inside dia.

Force main material (i.e., PVC C-900 class 150, ductile iron class 52, HDPE DR17 class 100, etc.):
DUAL PVC C900

Force Main is: New New Existing

2. Elevation change from lift station site to force main discharge point: _____ -0.5 ft.

Finish grade elevation at wet well: _____ 138.5 ft.

Discharge piping elevation at valve vault: _____ 135.95 ft.

Force main discharge elevation: _____ 138 ft.

3. Influent sewer elevation: _____ 134 ft.

4. Peak design flow (maximum flow to lift station):
1035 BOTH PUMPS g.p.m.

5. Standby generator requirement: None Permanent Portable None Don't Know

Standby generator fuel: SELECT ONE Diesel Natural Gas Propane

6. Available power supply:

480V 208V 240V 480V

3-phase Single-phase 3-phase

Additional loads on site (besides the lift station) to be powered by generator: _____ KVA

7. Electrical controls weather protection: SELECT ONE Enclosed Building Shelter Structure None

Weather protection structure is for: SELECT ONE Electrical Controls Only

Electrical Controls & Generator

Controls, Generator, Chemical Feed