


4.02 LIFT STATION DESIGN CRITERIA FORM

PART 2: DESIGN DATA

If using assumed elevations, note this in Additional Information.

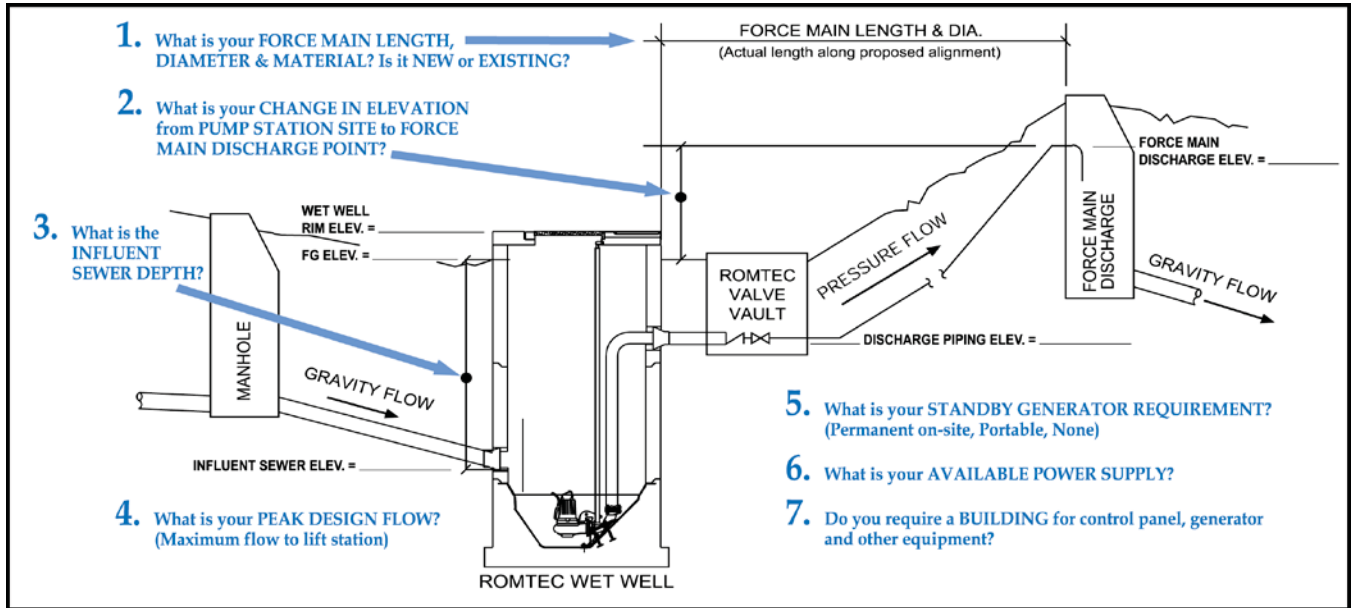

1.	Force main length:	<u>1720</u> ft.	(actual length along proposed alignment)	
	Force main diameter (inside):	<u>4.3</u> in.	inside dia.	
	Force main material (i.e., PVC C-900 class 150, ductile iron class 52, HDPE DR17 class 100, etc.):	<u>DI</u>		
	Force Main is:	<input checked="" type="checkbox"/> Existing	<input type="checkbox"/> New	<input type="checkbox"/> Existing
2.	Elevation change from lift station site to force main discharge point:	<u>11</u> ft.		
	Finish grade elevation at wet well:	<u>4102</u> ft.		
	Discharge piping elevation at valve vault:	<u>4098</u> ft.		
	Force main discharge elevation:	<u>4113</u> ft.		
3.	Influent sewer elevation:	<u>4093.79</u> ft.		
4.	Peak design inflow (maximum flow to lift station):	<u>65</u> g.p.m.	@ 35' TDH	
5.	Standby generator requirement:	<input checked="" type="checkbox"/> None	<input type="checkbox"/> Permanent	<input type="checkbox"/> Portable
	Standby generator fuel:	<input checked="" type="checkbox"/> SELECT ONE	<input type="checkbox"/> Diesel	<input type="checkbox"/> Natural Gas
			<input type="checkbox"/> Propane	<input type="checkbox"/> Don't Know
6.	Available power supply:	<input checked="" type="checkbox"/> 480V	<input type="checkbox"/> 208V	<input type="checkbox"/> 240V
		<input checked="" type="checkbox"/> 3-phase	<input type="checkbox"/> Single-phase	<input type="checkbox"/> 480V
	Additional loads on site (besides the lift station) to be powered by generator:	<u> </u>	KVA	