PRELIMINARY SITE LAYOUT

BASED ON SITE PLANS RECEIVED 6-19-18

WET WELL DEPTH: 25' [7.62m]
DISTANCE TO TERMINATION: 26.2' [8m]
NOTE: CABLES TO BE TERMINATED IN APPROVED JUNCTION BOX OR CONTROL PANEL.

APPROX. CABLE LENGTH NEEDED: 60.4' [18.4m]
PUMP CABLE LENGTH: 100' [30.4m]
TRANSDUCER CABLE LENGTH: 98' [30m]
FLOAT CABLE LENGTH: 98' [30m]

NOTE: SITE MATERIALS, DESIGN INFORMATION, AND SERVICES **NOT** SUPPLIED BY ROMTEC UTILITIES:
- GRADING
- WIRING AND CONDUIT
- FENCING AND PAVING
- SITE LIGHTING
- SITE UTILITIES (WATER, POWER, ETC)
- SCADA ANTENNA
- ALL ON-SITE INSTALLATION

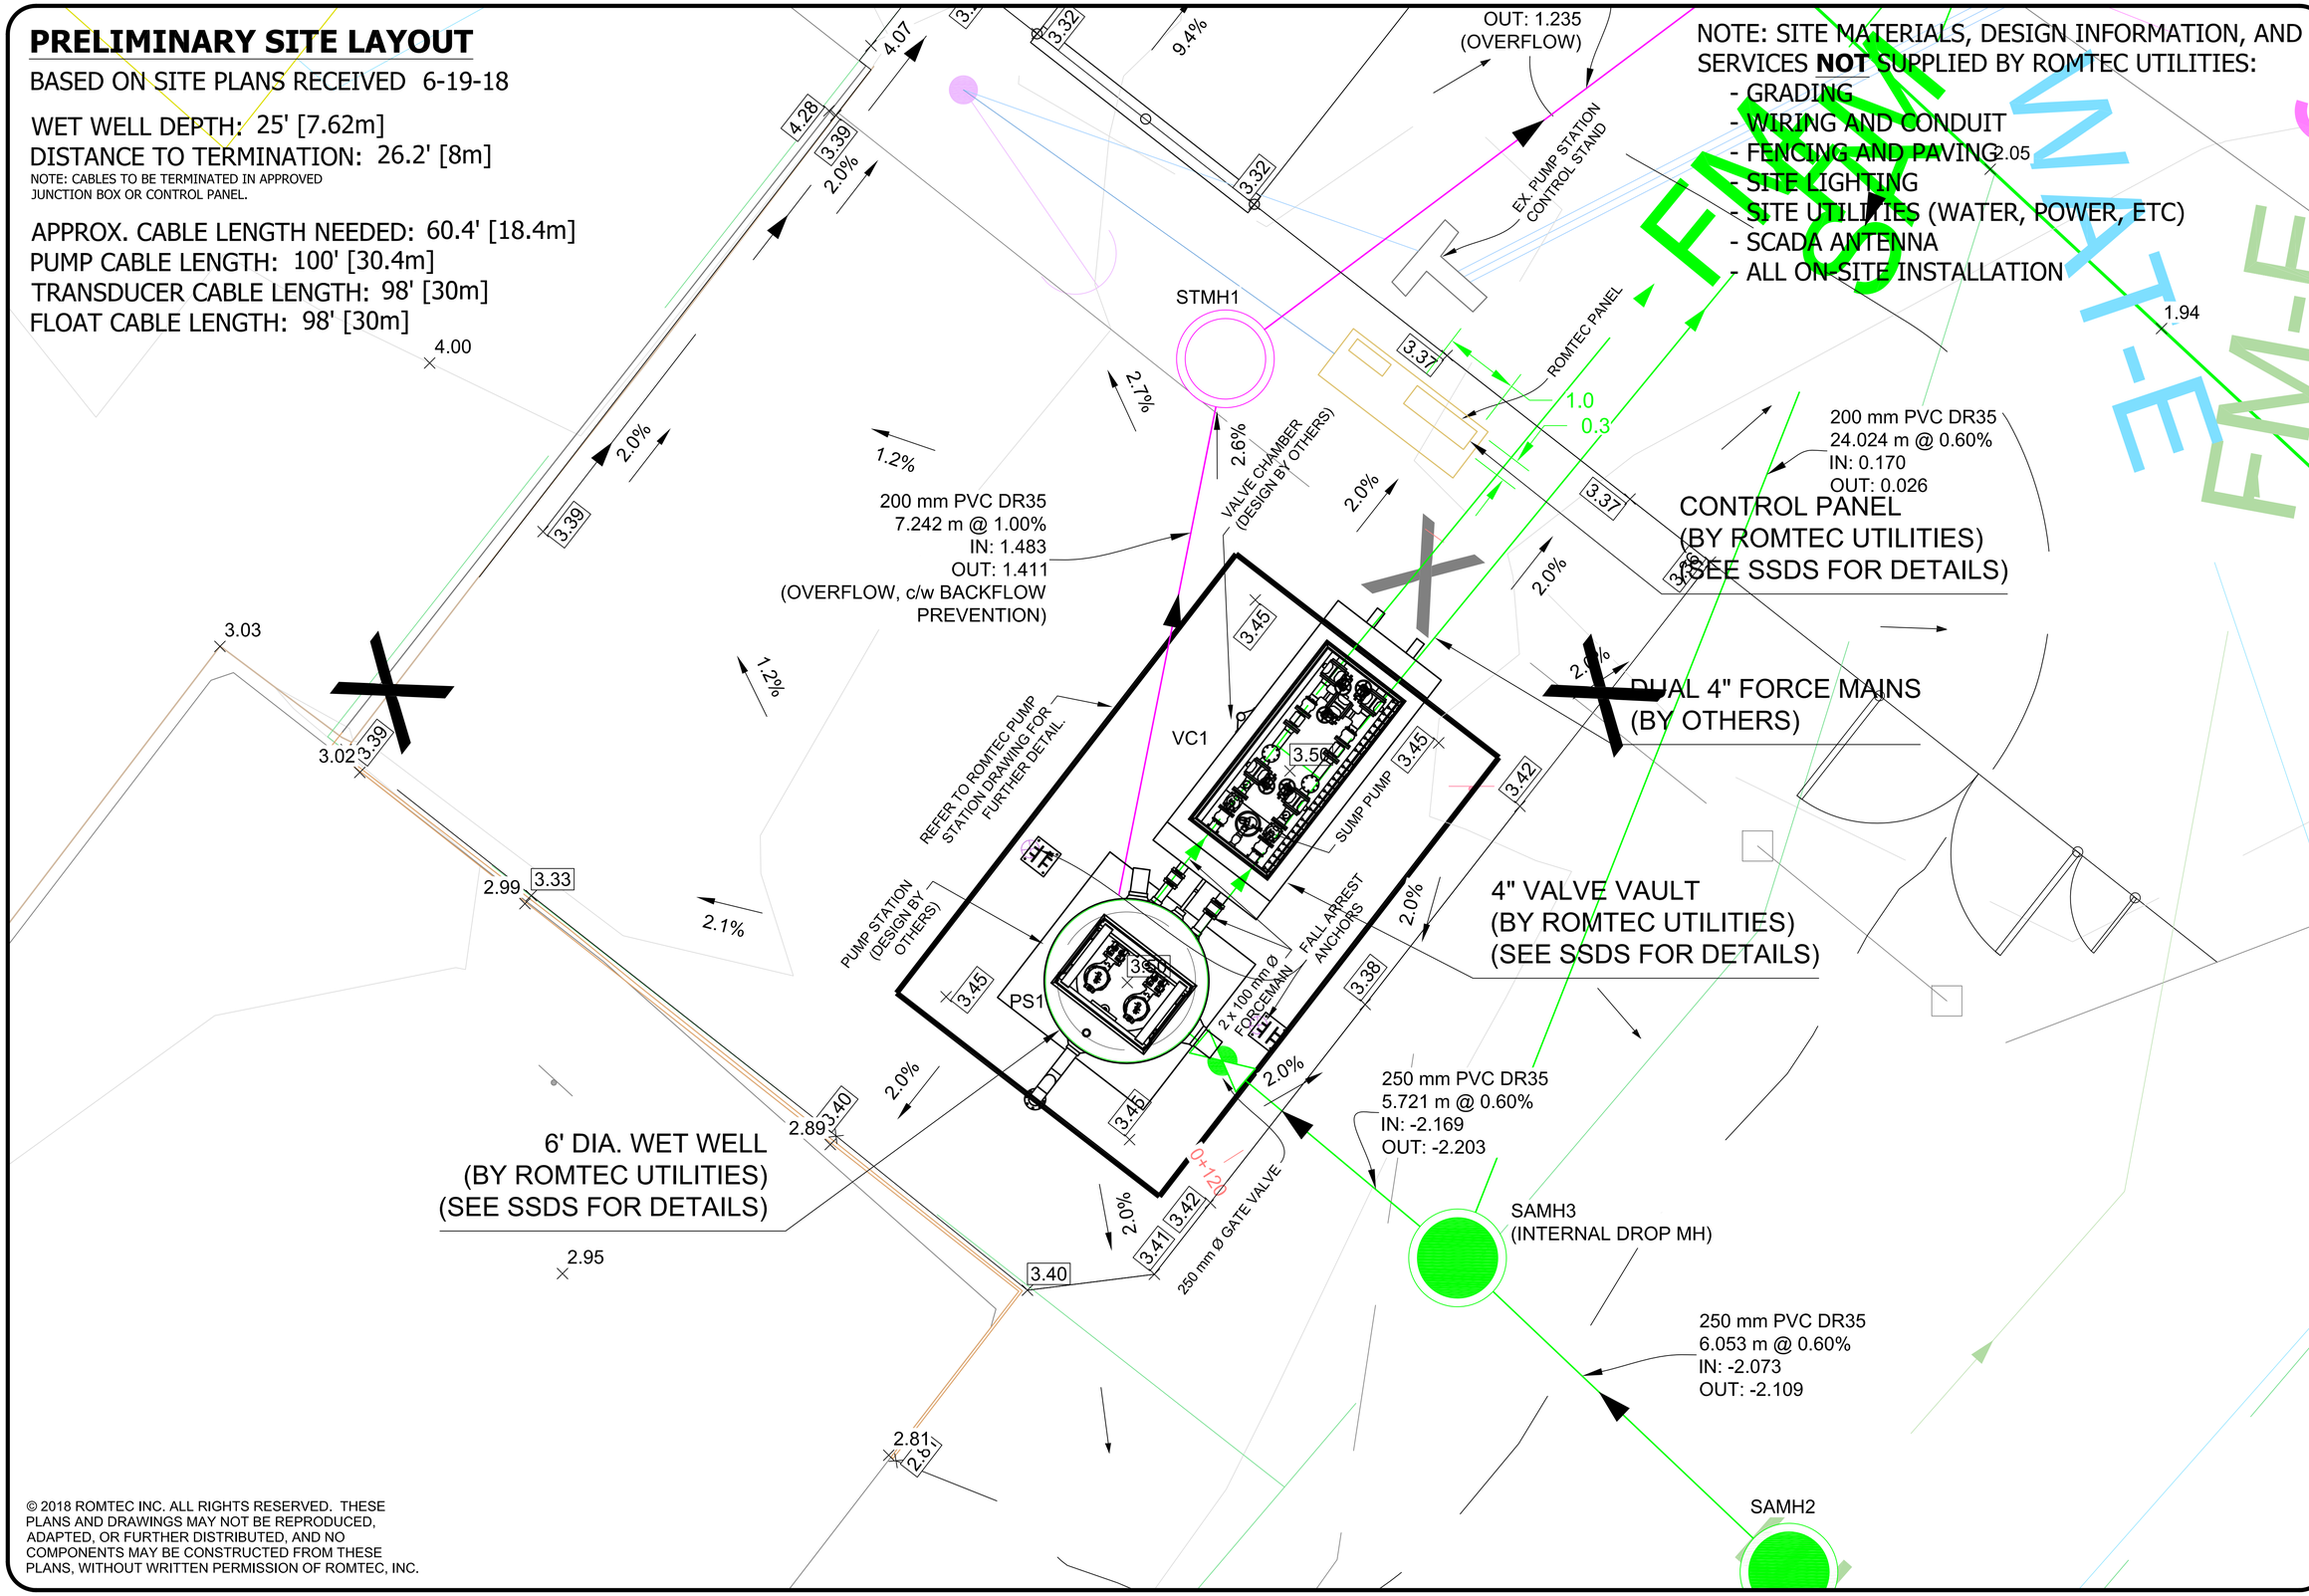

© 2018 ROMTEC INC. ALL RIGHTS RESERVED. THESE PLANS AND DRAWINGS MAY NOT BE REPRODUCED, ADAPTED, OR FURTHER DISTRIBUTED, AND NO COMPONENTS MAY BE CONSTRUCTED FROM THESE PLANS, WITHOUT WRITTEN PERMISSION OF ROMTEC, INC.

REV	DATE	DESCRIPTION	BY

REVISION HISTORY

VERIFY SCALE
0 — 1"
IF NOT ONE INCH ON THIS SHEET, ADJUST SCALE ACCORDINGLY

DSN:
DRN: KEVIN BOGAN
CKD:
DATE: 6-21-18

18240 NORTH BANK ROAD
ROSEBURG, OREGON 97470
PHONE: (541) 496-9678
WWW.ROMTECUTILITIES.COM

SHIPYARD ROAD
HALIFAX, NS, CANADA
ALL ASSEMBLIES
LAYOUT DRAWING

MECHANICAL SHEET
3 OF 3