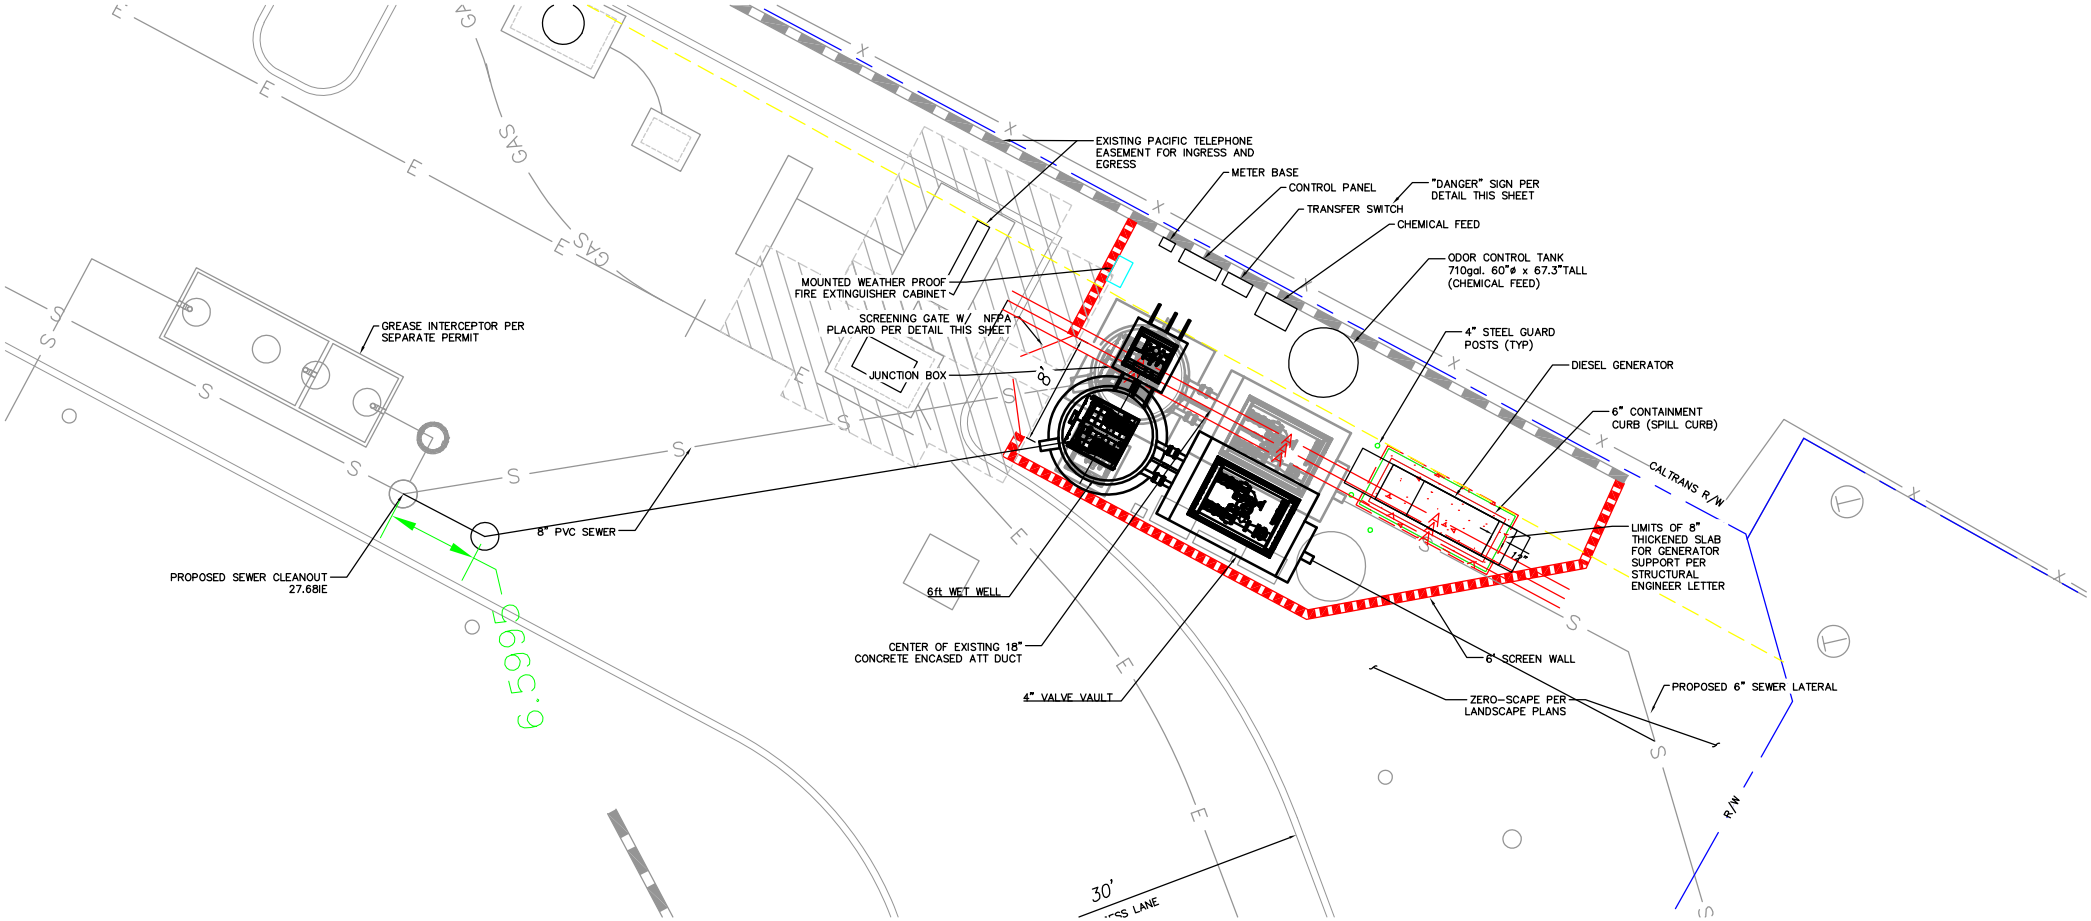
EXISTING PACIFIC TELEPHONE EASEMENT FOR INGRESS AND EGRESS
METER BASE
CONTROL PANEL
"DANGER" SIGN PER DETAIL THIS SHEET
TRANSFER SWITCH
CHEMICAL FEED
ODOR CONTROL TANK 710gal. 60"ø x 67.3"TALL (CHEMICAL FEED)
MOUNTED WEATHER PROOF FIRE EXTINGUISHER CABINET
SCREENING GATE W/ NFPA PLACARD PER DETAIL THIS SHEET
JUNCTION BOX
4" STEEL GUARD POSTS (TYP)
DIESEL GENERATOR
6" CONTAINMENT CURB (SPILL CURB)
CALTRANS R/W
GREASE INTERCEPTOR PER SEPARATE PERMIT
8" PVC SEWER
PROPOSED SEWER CLEANOUT 27.68IE
6ft WET WELL
CENTER OF EXISTING 18" CONCRETE ENCASED ATT DUCT
4" VALVE VAULT
LIMITS OF 8" THICKENED SLAB FOR GENERATOR SUPPORT PER STRUCTURAL ENGINEER LETTER
6' SCREEN WALL
ZERO-SCAPE PER LANDSCAPE PLANS
PROPOSED 6" SEWER LATERAL
R/W
6.599'
30'