

**PROJECT INFO**

Job Name:	Dolce Vita at Granbury
Company:	Texas Water
Contact:	Victoria Foss
Job Type:	New Station
Water Type/Source:	Wastewater (Sewage)
Import/Domestic:	Import Acceptable



**PACKAGE/STARTUP**

Offering:	Complete System
Mechanical:	All by Romtec Utilities
Pumps:	By Romtec Utilities
Control Panel:	By Romtec Utilities
Generator:	N/A
Advisor/Startup:	Mechanical & Electrical
Turnkey:	No

**DESIGN CRITERIA**

**FLOW RATE**

Peak Inflow:	486	GPM
Pumping Rate:	486	GPM (of single pump)
Static Head:	24.3	Feet
TDH:	29.0	Feet
TDH Calcs:	RU Calcs	

**ACTIVE VOLUME**

Max Pump Starts:	10.00	Starts/Hr
Cycle Time:	6.00	Minutes
Active Volume:	729.00	Gallons
Active Volume:	97.46	Cu Feet
Well Shape:	Round	
Well Diameter:	8	Feet
Well Dimensions:	N/A	N/A
Cross-Section Area:	50.27	Sq Feet
Min. Depth Required:	1.94	Feet
Active Depth:	2.00	Feet

**STORAGE VOLUME (if required)**

Time:		Minutes
Flow Rate:		GPM
Volume:	0.00	Gallons
Volume:	0.00	Cu. Feet
Min. Depth Required:	0.00	Feet
Storage Depth:		Feet

**ON-SITE POWER**


Power:	208V / 3-Phase
--------	----------------

**FORCE MAIN**

FM Info:	New	Single FM	
Length:	93	Feet	
FM Discharge:	733.29	Feet	
FM High Point:	733.29	Feet	
	(1)	(2)	(3)
Nominal ID:	6"		
Type/Rating:	PVC C900 DR18		

**INFLUENT PIPING**

	(1)	(2)	(3)
Influent Invert:	713.4		
Influent Size:	10"		
Type:	PVC (IPS)		

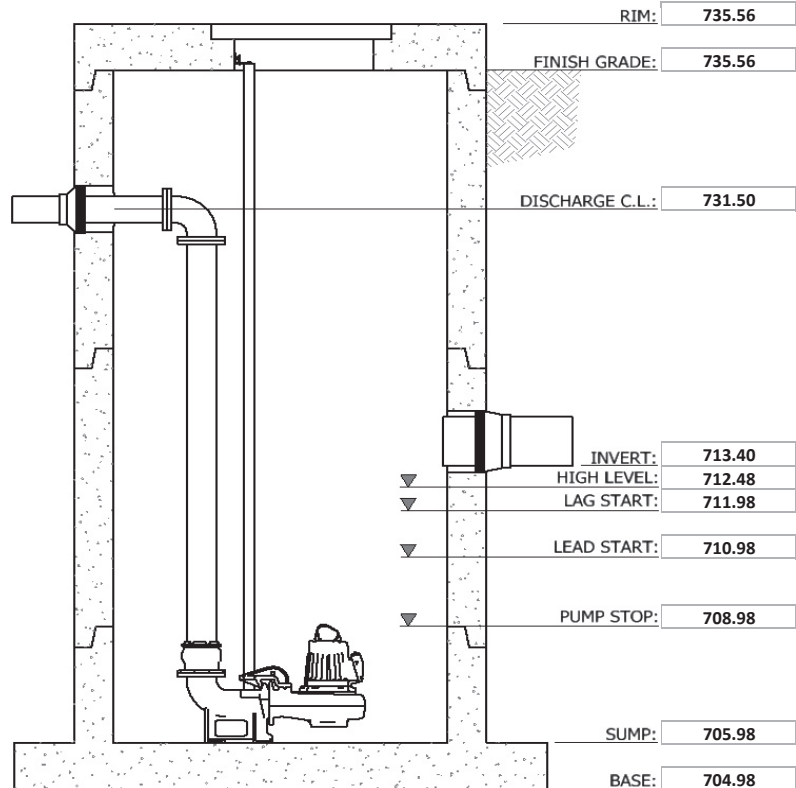

Note: Image is a preliminary representation of the pumping system. Elevations shown are the primary factors used for sizing the wet well. Backup levels not shown. Additional (or fewer) level settings may be required.