PROJECT INFO Wilsonville HS Auditorium Job Name: Company kpff Contact Kim Dorr **New Station** Job Type: Water Type/Source Wastewater (Sewage) Import/Domestic: Import Acceptable



PACKAGE/STARTUP				
Offering:	Complete System			
Mechanical:	All by Romtec Utilities			
Pumps:	By Romtec Utilities			
Control Panel:	By Romtec Utilities			
Generator:	N/A			
Advisor/Startup:	Mechanical & Electrical			
Turnkey:	No			

DESIGN CRITERIA - WWC6D-VM-D0075-300x30-4D-43-0

FLOW RATE 328 Peak Inflow: 328 GPM (of single pump) Pumping Rate: Static Head 18.1 Feet TDH: 27.3 Feet TDH Calcs: **RU Calcs**

ACTIVE VOLUME

C Mir

Max Pump Starts:	10.00	Starts/Hr
Cycle Time:	6.00	Minutes
Active Volume:	492.00	Gallons
Active Volume:	65.77	Cu Feet
Well Shape:	Round	
Well Diameter:	6	Feet
Well Dimensions:	N/A	N/A
Cross-Section Area:	28.27	Sq Feet
n. Depth Required:	2.33	Feet
Active Depth:	2.40	Feet

STORAGE VOLUME (if required)

Time:		Minutes
Flow Rate:		GPM
Volume:	0.00	Gallons
Volume:	0.00	_ Cu. Feet
Min. Depth Required:	0.00	Feet
Storage Depth:		Feet

ON-SITE POWER


480V / 3-Phase Power

FORCE MAIN

FM Info:	New	Single FM	
Length:	185	Feet	
FM Discharge:	184.52	Feet	
FM High Point:	191.00	Feet	
	(1)	(2)	(3)
Nominal ID:	6"		

Type/Rating: PVC C900 DR18

> (2) (1) (3) 178.57 189.91 183.34 PVC (DIPS)

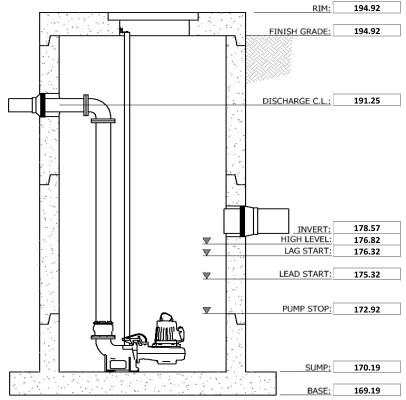

Note: Image is a preliminary representation of the pumping system. Elevations shown are the primary factors used for sizing the wet well. Backup levels not shown. Additional (or fewer) level settings may be required.

General Specification

Influent Invert:

Influent Size:

INFLUENT PIPING

Type:

- A. The package pump station supplier of the sewer lift station shall be Romtec Utilities. The package pump station supplier shall design and draw the complete lift station including the wet well structure and associated piping and valves along with the control panel and the associated schematics.
- B. The package pump station supplier shall be solely responsible for proper prefabrication, integration, supply, performance, and warranty of all package pump station components delineated in this specification and on the drawings, which shall be used as a guide of the minimum product specifications that shall be met.
- C. The package pump station supplier work shall include designing and supplying the piping, mechanical, and appurtenances within and adjacent to the wet well as a complete, predesigned, packaged pump station as described herein.
- D. The drawings shall be of sufficient detail for the Engineer to review for conformity to the contract. All drawings shall include elevations on the same datum point as in the contract plans.
- E. Romtec Utilities will manufacture and deliver the pump station as described below to the job site for the contractor. A representative of Romtec Utilities will be present the day of the underground installation.
- F. The package pump station supplier is responsible for overseeing all start-up, testing and training procedures.