


PART 2: DESIGN DATA

If using assumed elevations, note this in Additional Information.

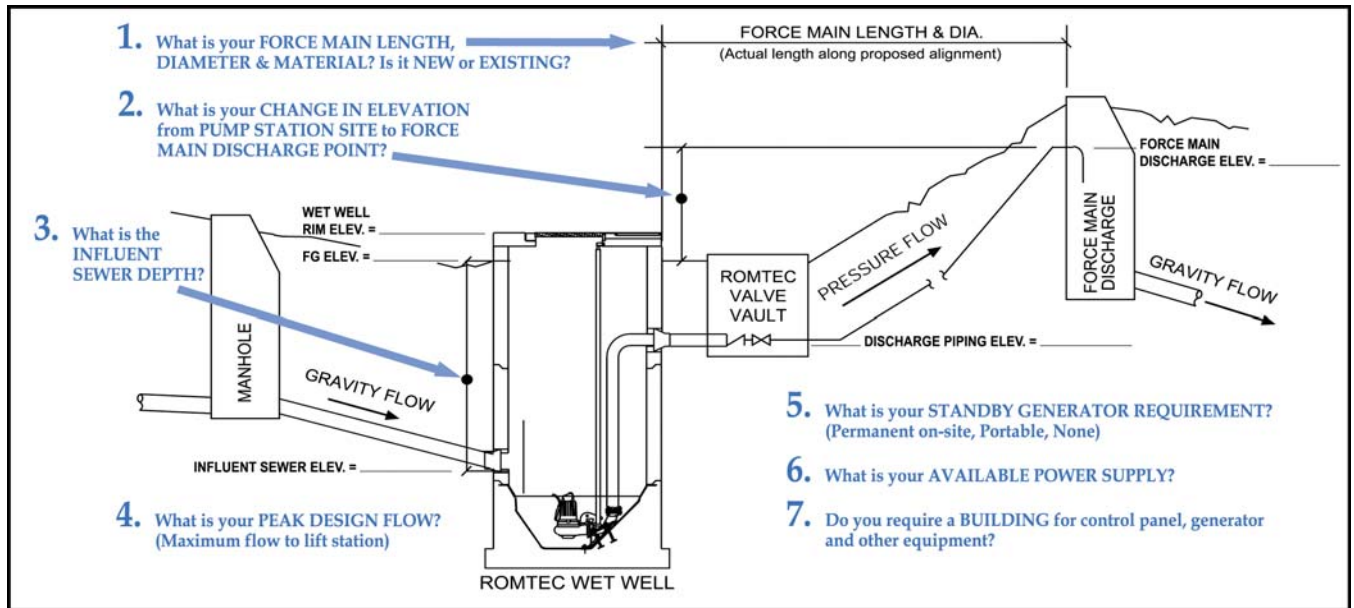

1. Force main length: 4362.45 ft. (actual length along proposed alignment)

Force main diameter (inside): 18" in. inside dia.

Force main material (i.e., PVC C-900 class 150, ductile iron class 52, HDPE DR17 class 100, etc.): C905 DR25

Force Main is: New New Existing

2. Elevation change from lift station site to force main discharge point: -0.5 ft.

Finish grade elevation at wet well: 2699.5 ft.

Discharge piping elevation at valve vault: 2695.93 ft. Centerline

Force main discharge elevation: 2699 ft.

3. Influent sewer elevation: 2681.44 ft. = 18" 2681.00 = 15" Centerline

4. Peak design flow (maximum flow to lift station): 2500 @ 55.71 g.p.m.

5. Standby generator requirement: None Permanent Portable None Don't Know

Standby generator fuel: SELECT ONE Diesel Natural Gas Propane

6. Available power supply: 480V 208V 240V 480V

3-phase Single-phase 3-phase

Additional loads on site (besides the lift station) to be powered by generator: _____ KVA

7. Electrical controls weather protection: None Enclosed Building Shelter Structure None

Weather protection structure is for: SELECT ONE Electrical Controls Only

APPROVED APPROVED WITH CHANGES